



IRON CITY ENTERPRISES
750 GAL SEPTIC/PUMP

Number of total gallons per vertical inch

1"	20
2"	40.1
3"	60.2
4"	80.4
5"	100.7
6"	121
7"	141.4
8"	161.5
9"	182.4
10"	203
11"	223.3
12"	244
13"	264.8
14"	285.7
15"	306.6
16"	327.6
17"	348.7
18"	369.8
19"	391.1
20"	412.4
21"	433.8
22"	455.2
23"	476.7
24"	498.2
25"	519.6
26"	541.4
27"	563
28"	584.6
29"	606.3
30"	628
31"	649.7
32"	671.5
33"	693.3
34"	715
35"	736.7
36"	758.5

Proper bedding/Backfilling-

- Tanks need to be properly bed with adequate sand or sewer stone capable of bearing the weight of the tank and all of its contents. There must be at least 3" of sand between the tank and bed rock.
- Tanks need to be back filled with a sandy material with minimal clay and no large rocks

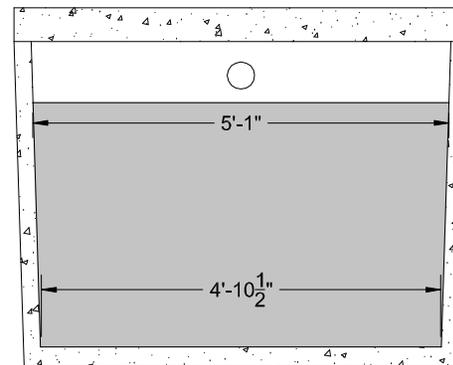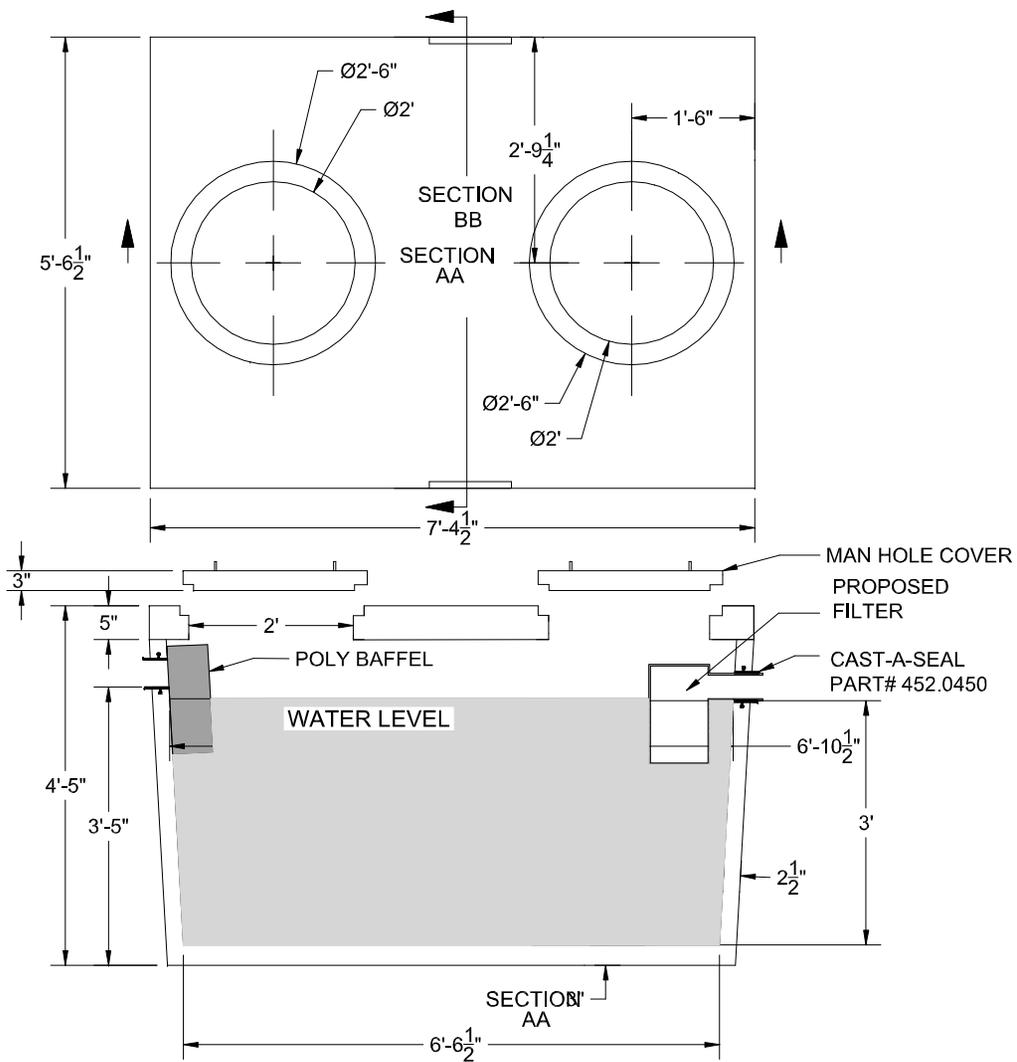

SECTION BB

