# WLP1645–MR
# TANK SPECIFICATIONS

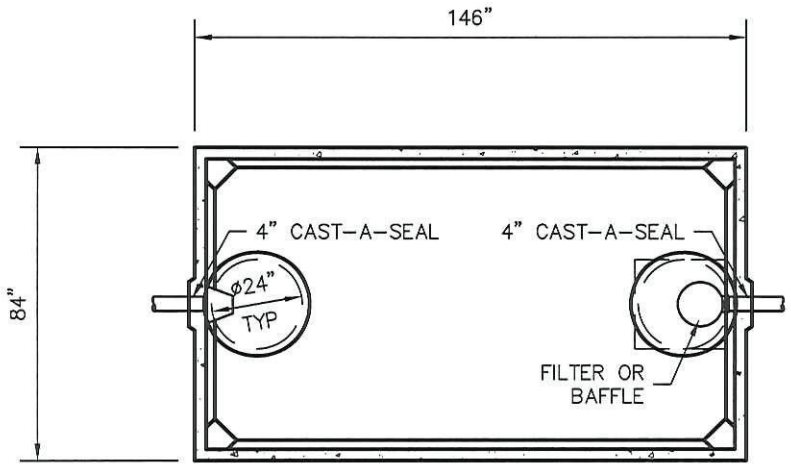


TOP VIEW

DIMENSIONS:
- WALL: 3"
- BOTTOM: SEPTIC 3"
- COVER: 5"
- MANHOLE: 24" I.D. PRECAST CONCRETE RISER
- HEIGHT: 54 1/2" O.D.
- LENGTH: 146" O.D.
- WIDTH: 84" O.D.
- BELOW INLET: 43" O.D.
- LIQUID LEVEL: 38"
- WEIGHT: 14,000 LBS.

INLET AND OUTLET:
- 4" CAST–A–SEAL BOOT OR EQUAL
- GASKET, CAST–A–SEAL BOOT OR EQUAL

INLET AND OUTLET BAFFLE AND FILTER:
- WISCONSIN, SEE DETAIL #10
- (OTHER STATES SEE CHART)

LIQUID CAPACITY: 43.32 GAL/IN

HOLDING TANK:
- OUTLET HOLE PLUGGED
- ACTUAL CAPACITY: 1,733 GALLONS

LOADING DESIGN: 8' 0" UNSATURATED SOIL

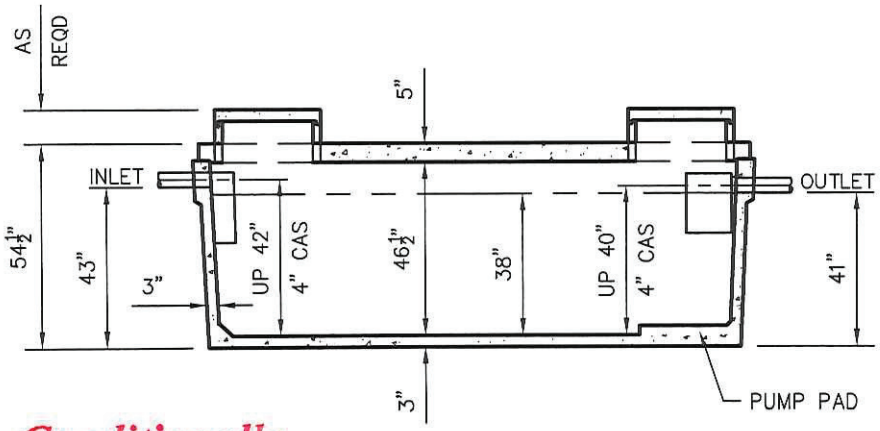


SIDE VIEW

TANK CAN BE USED AS:
- SEPTIC/ HOLDING/ PUMP OR SIPHON

COVER: MIX DESIGN #8 (NO FIBER)
TANK: MIX DESIGN #10 (STRUCTURAL FIBER)

CUSTOMIZED TANKS:
- FOR CUSTOM TANKS CONTACT WIESER CONCRETE

20130154 A

RECEIVED
MAY 13 2013
SAFETY & BUILDINGS

DRAWINGS SUBMITTED FOR APPROVAL
APPROVED BY: _____
APPROVAL DATE: _____
PRODUCTS NEEDED BY: _____

Conditionally APPROVED

TANKS ARE MANUFACTURED TO MEET OR EXCEED ASTM C–1227 REQUIREMENTS

SEE CORRESPONDENCE

PRE–POUR: | POST–POUR:
SCALE: 1/4"=1'–0" | REV. | DATE:
DRAWN BY: WCP | DATE: 00/00/00
FILE: WLP1645–MR


WIESER CONCRETE
W3716 US HWY 10 MAIDEN ROCK, WI 54750
800–325–8456


WLP1645–MR
SEPTIC MANUAL

SHEET NO. 1 OF 1