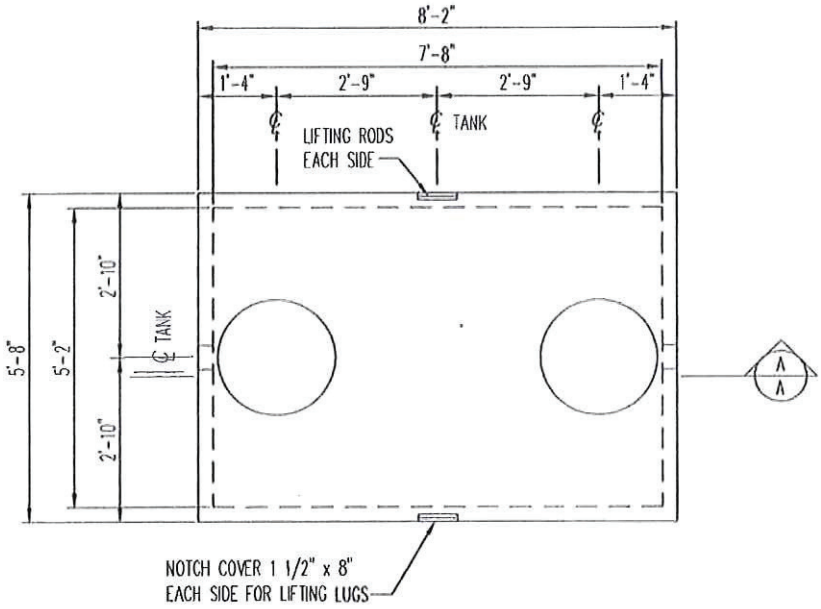

1000 GALLON TANK
1/2" = 1'-0"

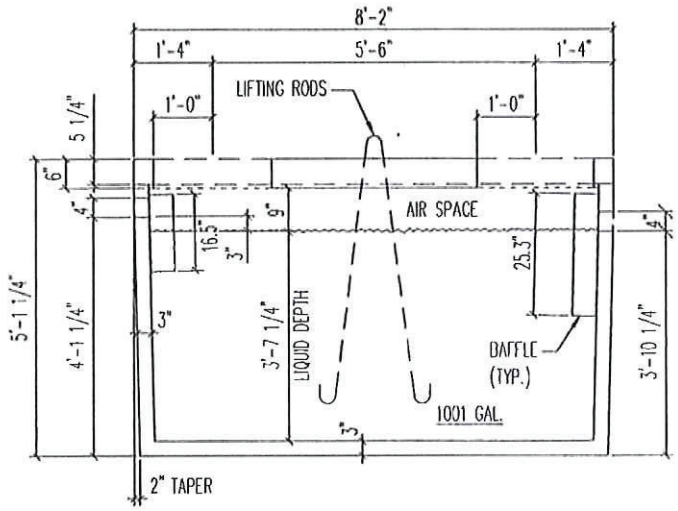

A
A
SECTION
1/2" = 1'-0"

NOTE:
1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.
2. PUMP TANK (PT) HAS NO OUTLET BAFFLE.

Conditionally APPROVED
SEE CORRESPONDENCE

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1000 GALLON SEPTIC OR PUMP TANK (1000 ST OR 1000 PT)	Brown Wilbert	WEIGHT=8650# MAX. SOIL COVER= 8'-0"

20140127

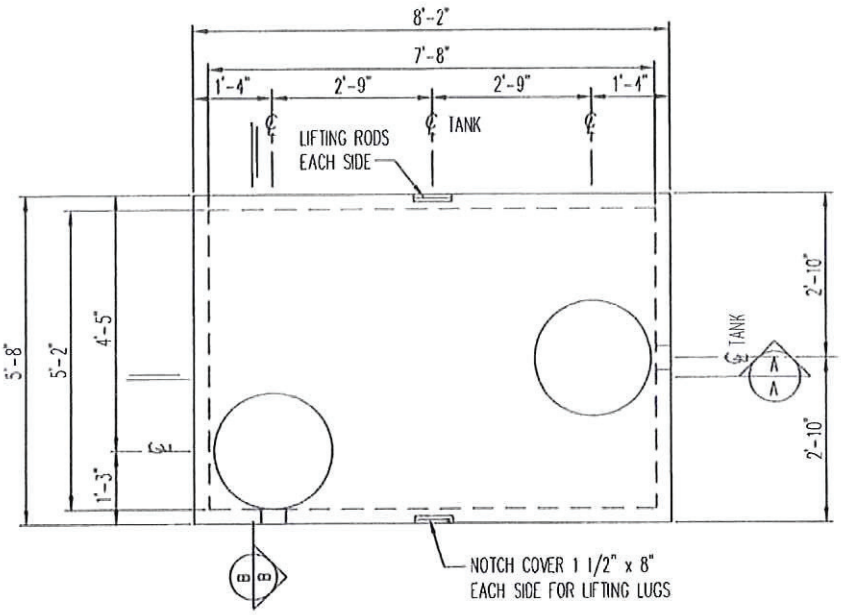

1000 GALLON TANK
1/2" = 1'-0"

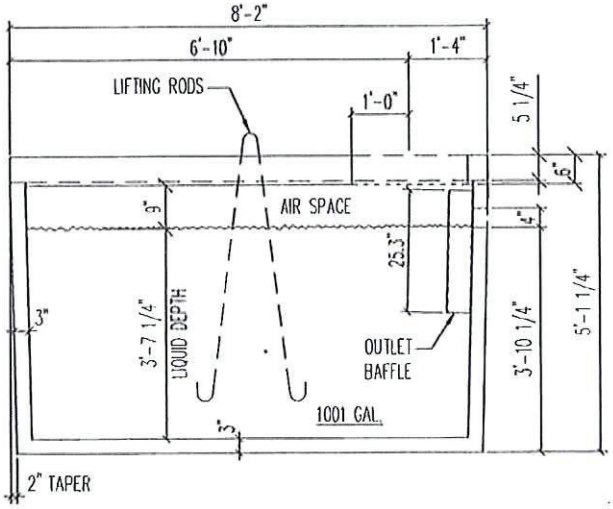

A
A
SECTION
1/2" = 1'-0"

NOTE:
1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.
2. PUMP TANK (PT) HAS NO OUTLET BAFFLE.

Conditionally APPROVED
SEE CORRESPONDENCE

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1000 GALLON SEPTIC OR PUMP TANK (1000 ST-R OR 1000 PT-R)	Brown Wilbert	WEIGHT=8650# MAX. SOIL COVER= 7'-0"

20140127

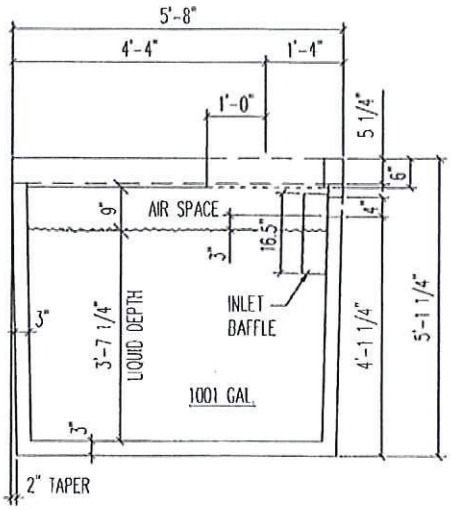

B/B SECTION
1/2" = 1'-0"

NOTE:
1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.
2. PUMP TANK (PT) HAS NO OUTLET BAFFLE.

Conditionally APPROVED
SEE CORRESPONDENCE

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1000 GALLON SEPTIC OR PUMP TANK (1000 ST-R OR 1000 PT-R)	Brown Wilbert	WEIGHT=8650# MAX. SOIL COVER= 7'-0"

20140127

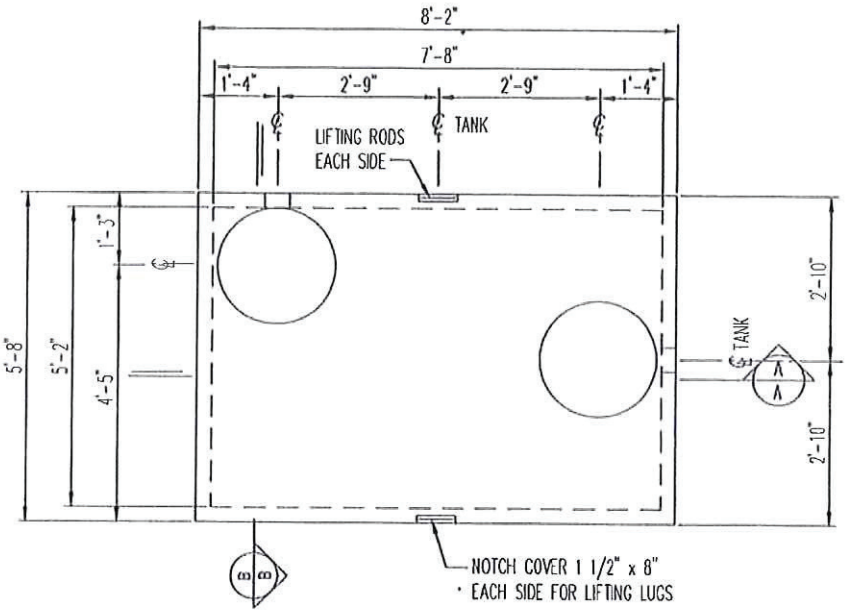

1000 GALLON TANK
1/2" = 1'-0"

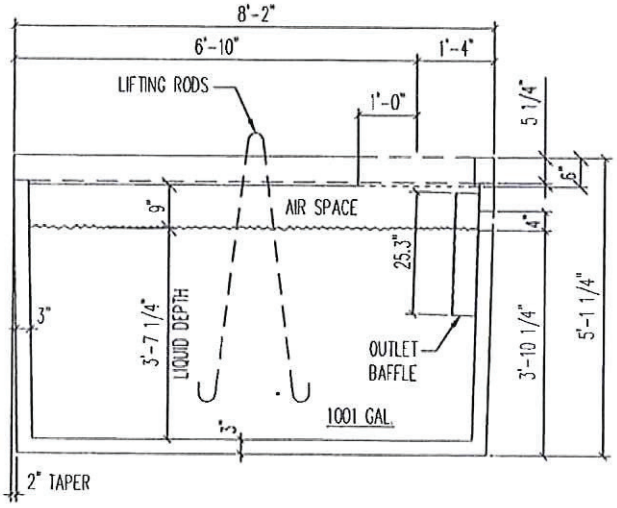

A
A
SECTION
1/2" = 1'-0"

Conditionally APPROVED
SEE CORRESPONDENCE

NOTE:
1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.
2. PUMP TANK (PT) HAS NO OUTLET BAFFLE.

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1000 GALLON SEPTIC OR PUMP TANK (1000 ST-L OR 1000 PT-L)	Brown Wilbert	WEIGHT=8650# MAX. SOIL COVER= 7'-0"

20140127

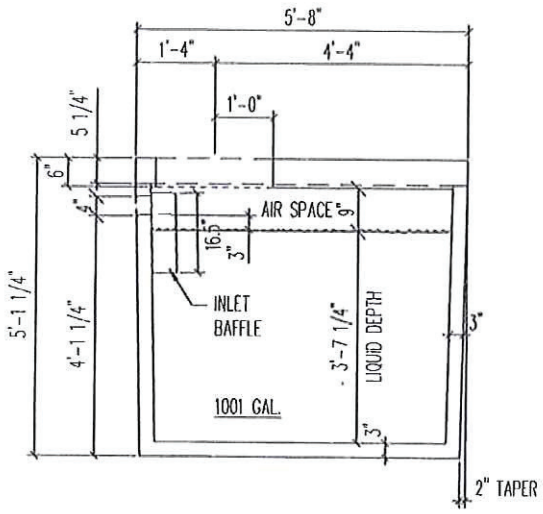

B/B SECTION

1/2" = 1'-0"

Conditionally APPROVED

SEE CORRESPONDENCE

NOTE:

1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.
2. PUMP TANK (PT) HAS NO OUTLET BAFFLE.

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1000 GALLON SEPTIC TANK (1000 ST-L OR 1000 PT-L)	Brown Wilbert	WEIGHT=8650# MAX. SOIL COVER= 7'-0"

20140127