20150063 A

STANDARD TANK DESIGN;
- 7FT OF COVER AT 120 PCF PLUS HS20-44 AXLE LOAD
- MAXIMUM LOAD ON TANK TOP CANNOT EXCEED 6.5 PSI
- MAXIMUM TEST PRESSURE - 5PSI

NOTES:
- WATER TANK TEST PER CSI PUB INST6038
- ONSITE WATER TIGHTNESS CERTIFICATION BY OTHERS.

NOTE: CUSTOMER SUPPLIED FLEXIBLE PIPING COUPLING REQUIRED ON TANGENTIALLY MTD. NOZZLES, STUB-OUTS & NPT FITTINGS.

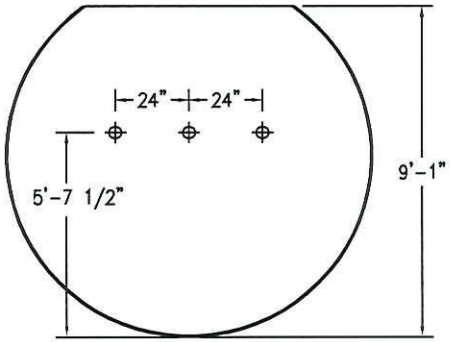

BAFFLE DETAIL

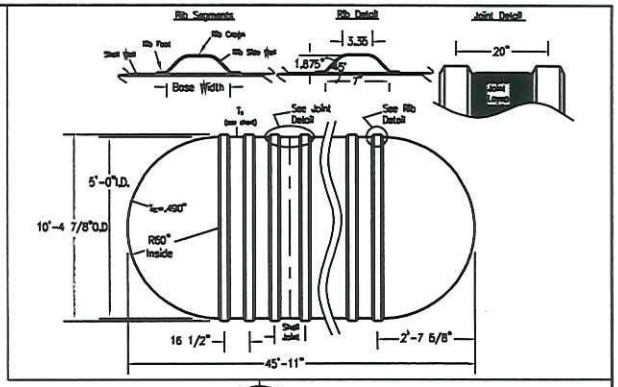

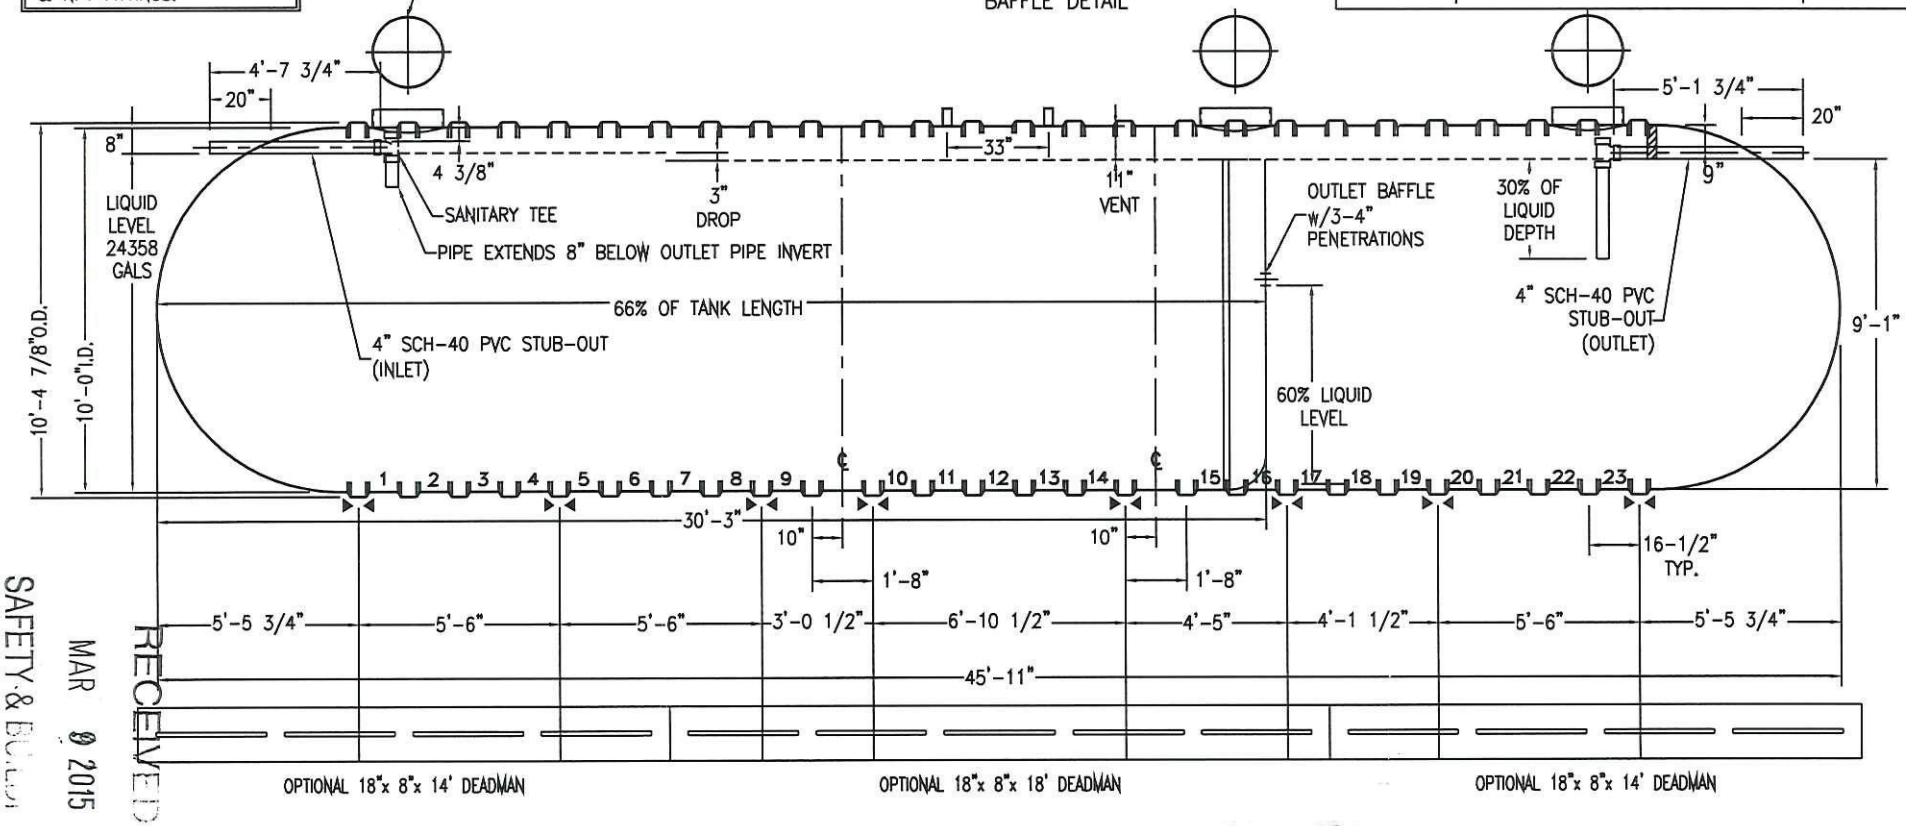

NOTES:
- ⊠ HOLD DOWN STRAP CLIP
- ▶◀ HOLD DOWN STRAP LOCATION
- ▯ TYPE "13" LIFT LUG - SD
- ▮ TYPE "13" LIFT LUG - HD

INLET CHAMBER CAPACITY = 16373 GALS
PUMP CHAMBER CAPACITY = 7985 GALS

RECEIVED
MAR 09 2015
SAFETY & BUILDING

Conditionally APPROVED
SEE CORRESPONDENCE

SWT D-6 (10')-25000		DATE: 8/1/2003
WISCONSIN DEPT OF COMMERCE		DRAWN BY: K.A.SOEDER
CONTAINMENT SOLUTIONS	CAPACITY: 24,970	REVISED: 5/10/10-KAS
	WEIGHT: DRY/WET 7550	DWG NUMBER: 10FT25MWISC