



20150093

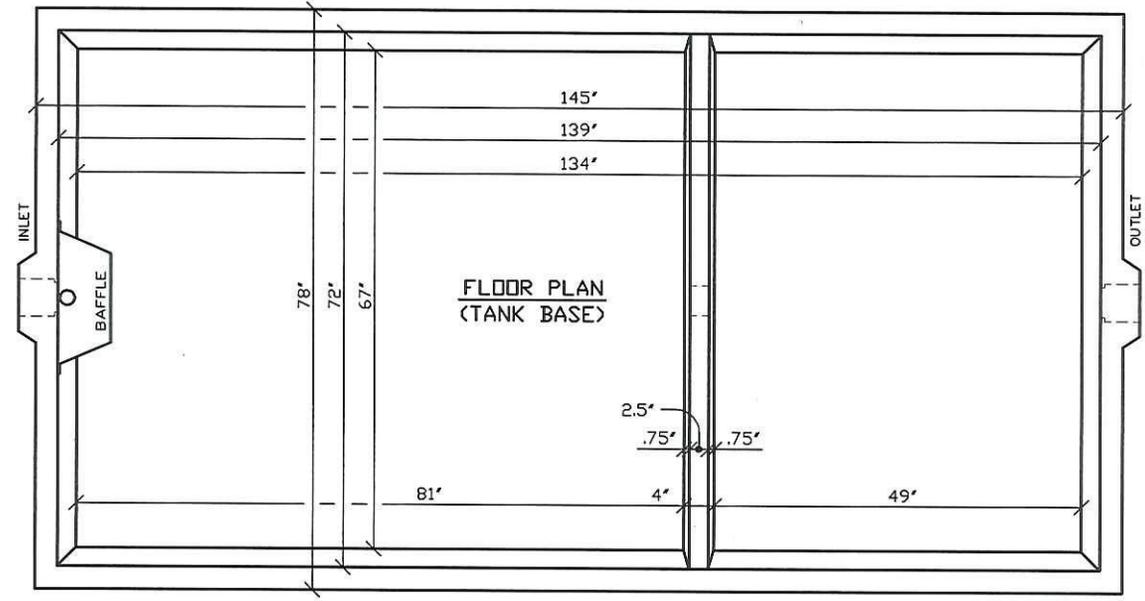

Conditionally APPROVED

SEE CORRESPONDENCE

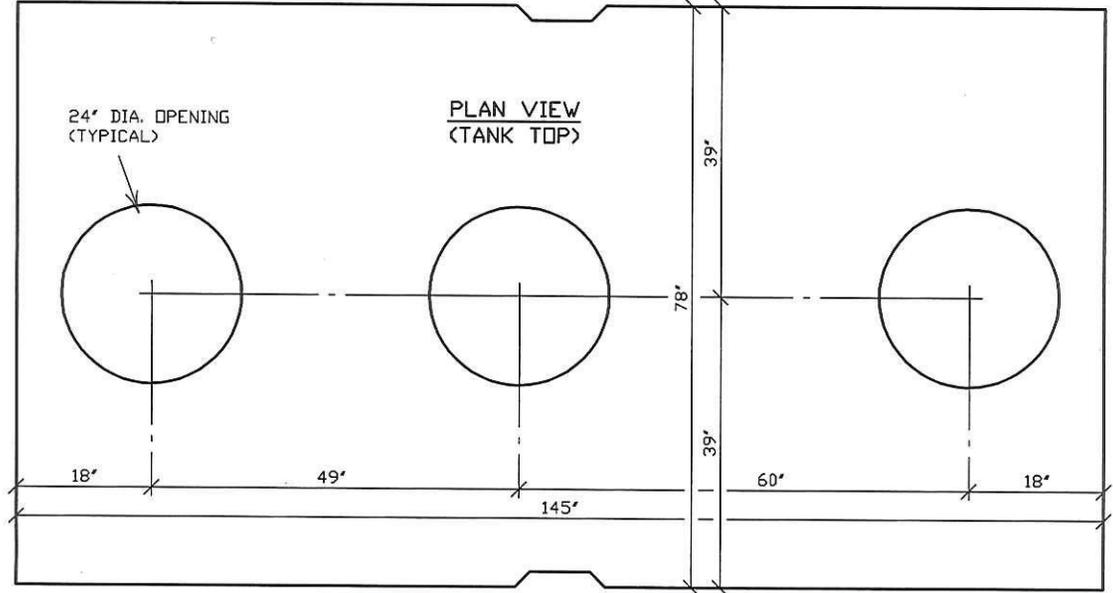

HUFFCUTT CONCRETE, INC.

4154 123rd STREET  
CHIPPEVA FALLS, VT 54729  
(715) 723-7446 \* (800) 924-1516  
FAX (715) 723-7111 \* www.huffcutt.com



PROJECT:  
1,000/600 GALLON  
PUMP DIR SEPTIC TANK

1 of 2

N.P.C.A. CERTIFIED PLANT & MEMBER OF:  
NATIONAL & WISCONSIN PRECAST CONCRETE ASSOCIATIONS



THIS DRAWING SHALL NOT BE COPIED OR SUBMITTED TO OTHERS WITHOUT THE CONSENT OF THIS COMPANY.

20150093

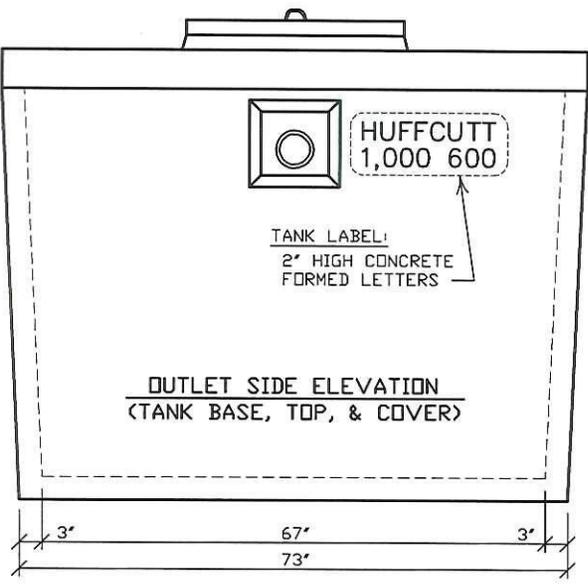

WARNING LABEL EMBEDDED INTO  
CONCRETE COVER READS AS FOLLOWS:  
CAUTION:  
DO NOT ENTER WITHOUT PROPER VENTILATION.  
COULD CAUSE DEATH...DANGEROUS GAS.

29" DIAMETER CONCRETE COVER (TYPICAL)  
SEE "ACCESSORIES" FOR OTHER COVER OPTIONS

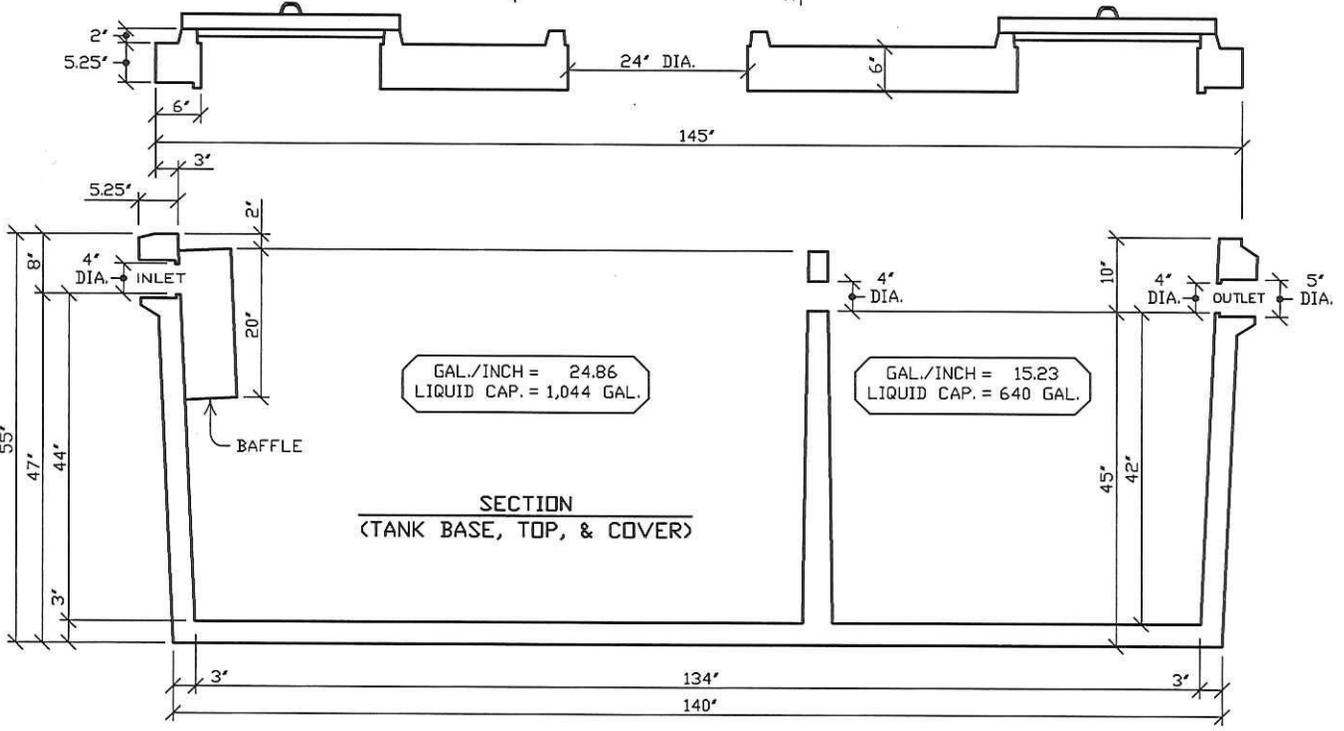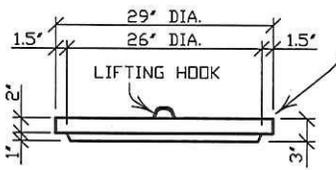

**Conditionally  
APPROVED**

SEE CORRESPONDENCE

N.P.C.A. CERTIFIED PLANT  
&  
MEMBER OF:  
NATIONAL & WISCONSIN PRECAST CONCRETE ASSOCIATIONS

THIS DRAWING SHALL NOT  
BE COPIED OR SUBMITTED  
TO OTHERS WITHOUT THE  
CONSENT OF THIS COMPANY.


4154 123rd STREET  
CHIPPEWA FALLS, WI 54729  
(715) 723-7446 \* (800) 924-1516  
FAX (715) 723-7111 \* www.huffcutt.com





**HUFFCUTT  
CONCRETE, INC**



PROJECT:  
1,000/600 GALLON  
PUMP OR SEPTIC TANK

**TANK SPECIFICATIONS:**

- 2' MINIMUM CLEARANCE BETWEEN TOP OF BAFFLE AND BOTTOM OF COVER.
- OPTIONAL OPENING FOR INLET AND OUTLET USING 4", 6", OR 8" DIAMETER PVC OR CAST IRON PIPE. (SAME SIZE ON EACH SIDE)
- OPTIONAL OPENING IN BOTTOM OF TANK USING 4", 6", OR 8" DIAMETER PVC OR CAST IRON PIPE. (FOR HOLDING TANKS ONLY)
- TYPICAL COVER & TOP OF TANK JOINT 
- TANK USED AS GREASE INTERCEPTOR:
  - THE WARNING LABEL ON ACCESSORY ITEM #1 IS ACCOMPANIED BY AN IDENTICAL SIZED LABEL READING 'GREASE INTERCEPTOR'.
  - INLET BAFFLE EXTENDS 1/3 BELOW WATERLINE AND OUTLET BAFFLE EXTENDS 2/3 BELOW WATERLINE.
  - TOP OF INLET AND OUTLET BAFFLES ARE LOCATED 2' BELOW BOTTOM OF TANK COVER.
  - HEIGHT OF INLET AND OUTLET BAFFLES ABOVE LIQUID LEVEL IS 6".
- TANK USED AS HOLDING TANK:
  - 12" MANHOLE RISER (ACCESSORY ITEM #3) IS CAST INTO THE COVER, IN PLACE OF ONE OF THE OPENINGS.
  - CONCRETE ADHERES TO COARSE SURFACE OF MANHOLE, AS WELL AS LOWER TONGUE & GROOVE.
  - VENT OR OBSERVATION HOLE IN PLACE OF THE OTHER OPENING. (ACCESSORY ITEM #6)
  - OUTLET TO BE PLUGGED BY APPROVED MEANS.
- MINIMUM CONCRETE COMPRESSIVE STRENGTH FOR THE TANK BASE & COVER AND MANHOLE RISER & COVER IS 4,000 PSI.
- SCH. 40 PVC OR CAST IRON PIPE, WHEN USED, WILL CONFORM TO ILHR TABLES 84.30-1&2 OF THE WISCONSIN ADMINISTRATIVE CODE.
- SEALANT FOR TANK COVER AND MANHOLE RISERS IS CONSEAL CS-101.

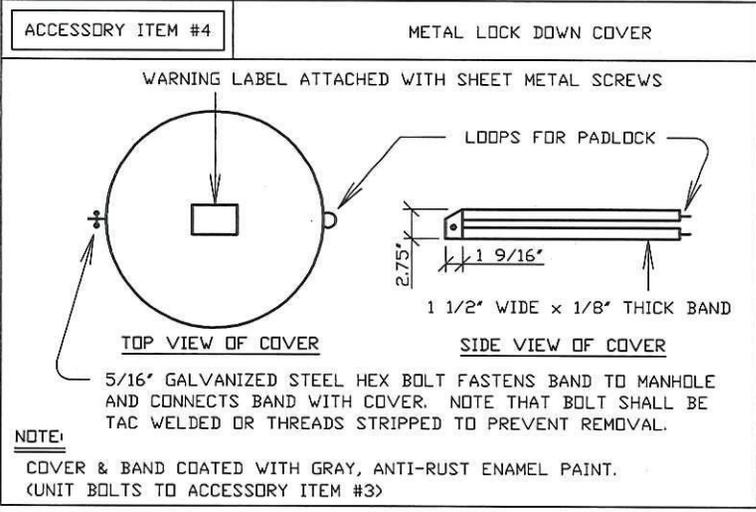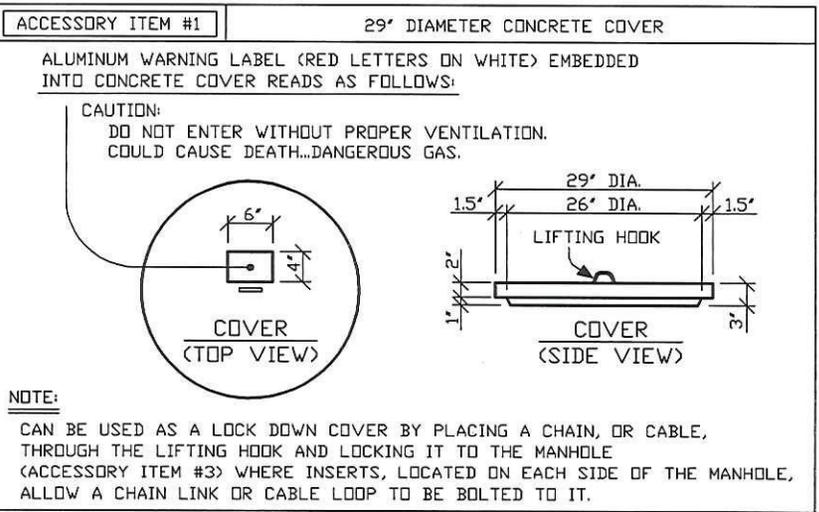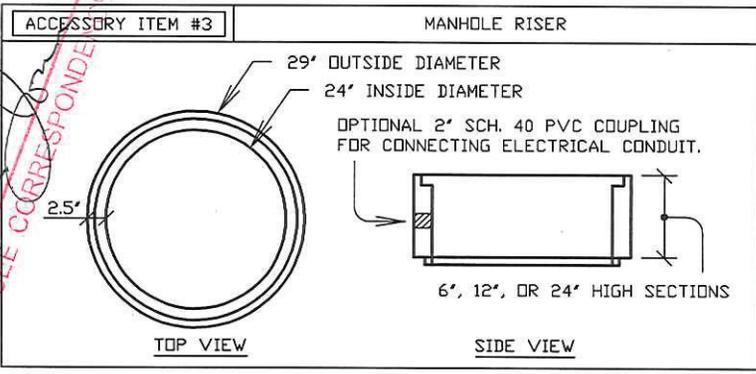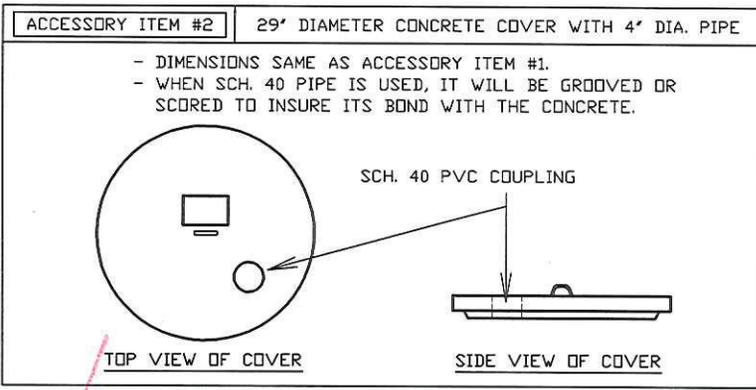

Conditionally APPROVED

SEE CORRESPONDENCE

N.P.C.A. CERTIFIED PLANT  
&  
MEMBER OF:  
NATIONAL & WISCONSIN PRECAST CONCRETE ASSOCIATIONS

4154 123rd STREET  
CHIPPEWA FALLS, WI 54729  
(715) 723-7446 x (800) 924-1516  
FAX (715) 723-7111 \* www.huffcutt.com

**H HUFFCUTT  
CONCRETE, INC**

PROJECT:  
ACCESSORIES


1 of 2

THIS DRAWING SHALL NOT BE COPIED OR SUBMITTED TO OTHERS WITHOUT THE CONSENT OF THIS COMPANY.

ACCESSORY ITEM #5


BAFFLE

- BAFFLE IS ATTACHED BY (4) 1/4" x 1 1/2" RAWL NYLON NAIL ANCHORS
- BAFFLE MADE OF POLYETHYLENE MATERIAL

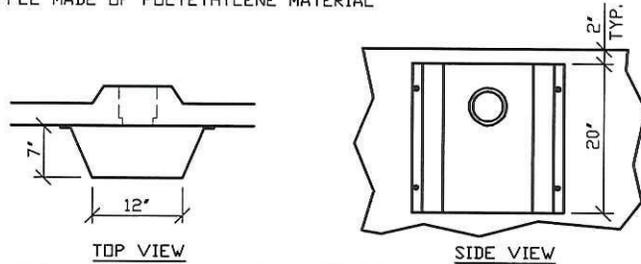


ACCESSORY ITEM #6

BOSS STOP

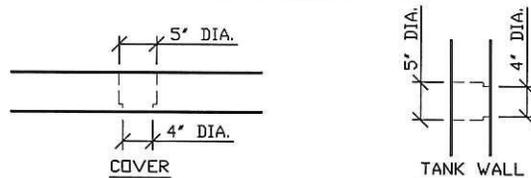

ACCESSORY ITEM #7


MANHOLE RISER WITH 4" OPENING

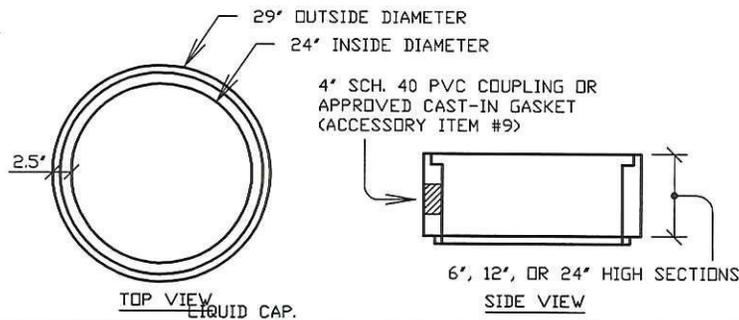

ACCESSORY ITEM #8


OUTLET OR INLET PLUG

OUTLET PLUGGED FOR HOLDING TANK AND FOR GREASE INTERCEPTOR TANK.



ACCESSORY ITEM #9

CAST-IN GASKET




ACCESSORY ITEM #10

BEST GF 10-8 FILTER (OR EQUAL)


NOTE:

ONE END OF A 4" SCH. 40 PVC PIPE IS GLUED INTO FILTER OPENING & THE OTHER END IS INSERTED THRU THE BOSS STOP WITH A GASKET OR GLUED TO A 4" SCH. 40 PVC COUPLING.

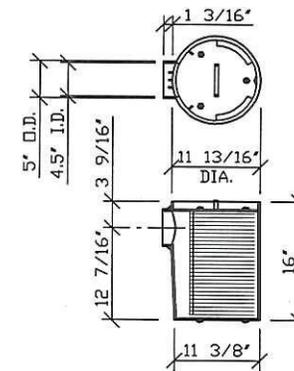

ACCESSORY ITEM #11

HOLDING TANK TOP (SECTION VIEW)

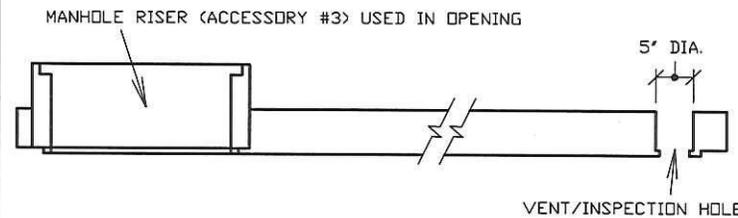

20150093

Conditionally APPROVED

*De Jones*  
SEE CORRESPONDENCE

N.P.C.A. CERTIFIED PLANT & MEMBER OF: NATIONAL & WISCONSIN PRECAST CONCRETE ASSOCIATIONS

THIS DRAWING SHALL NOT BE COPIED OR SUBMITTED TO OTHERS WITHOUT THE CONSENT OF THIS COMPANY.

4154 123rd STREET  
CHIPPEWA FALLS, WI 54729  
(715) 723-7446 \* (800) 924-1516  
FAX (715) 723-7111 \* www.huffcutt.com

**HUFFCUTT**  
CONCRETE, INC



PROJECT: ACCESSORIES

2 of 2