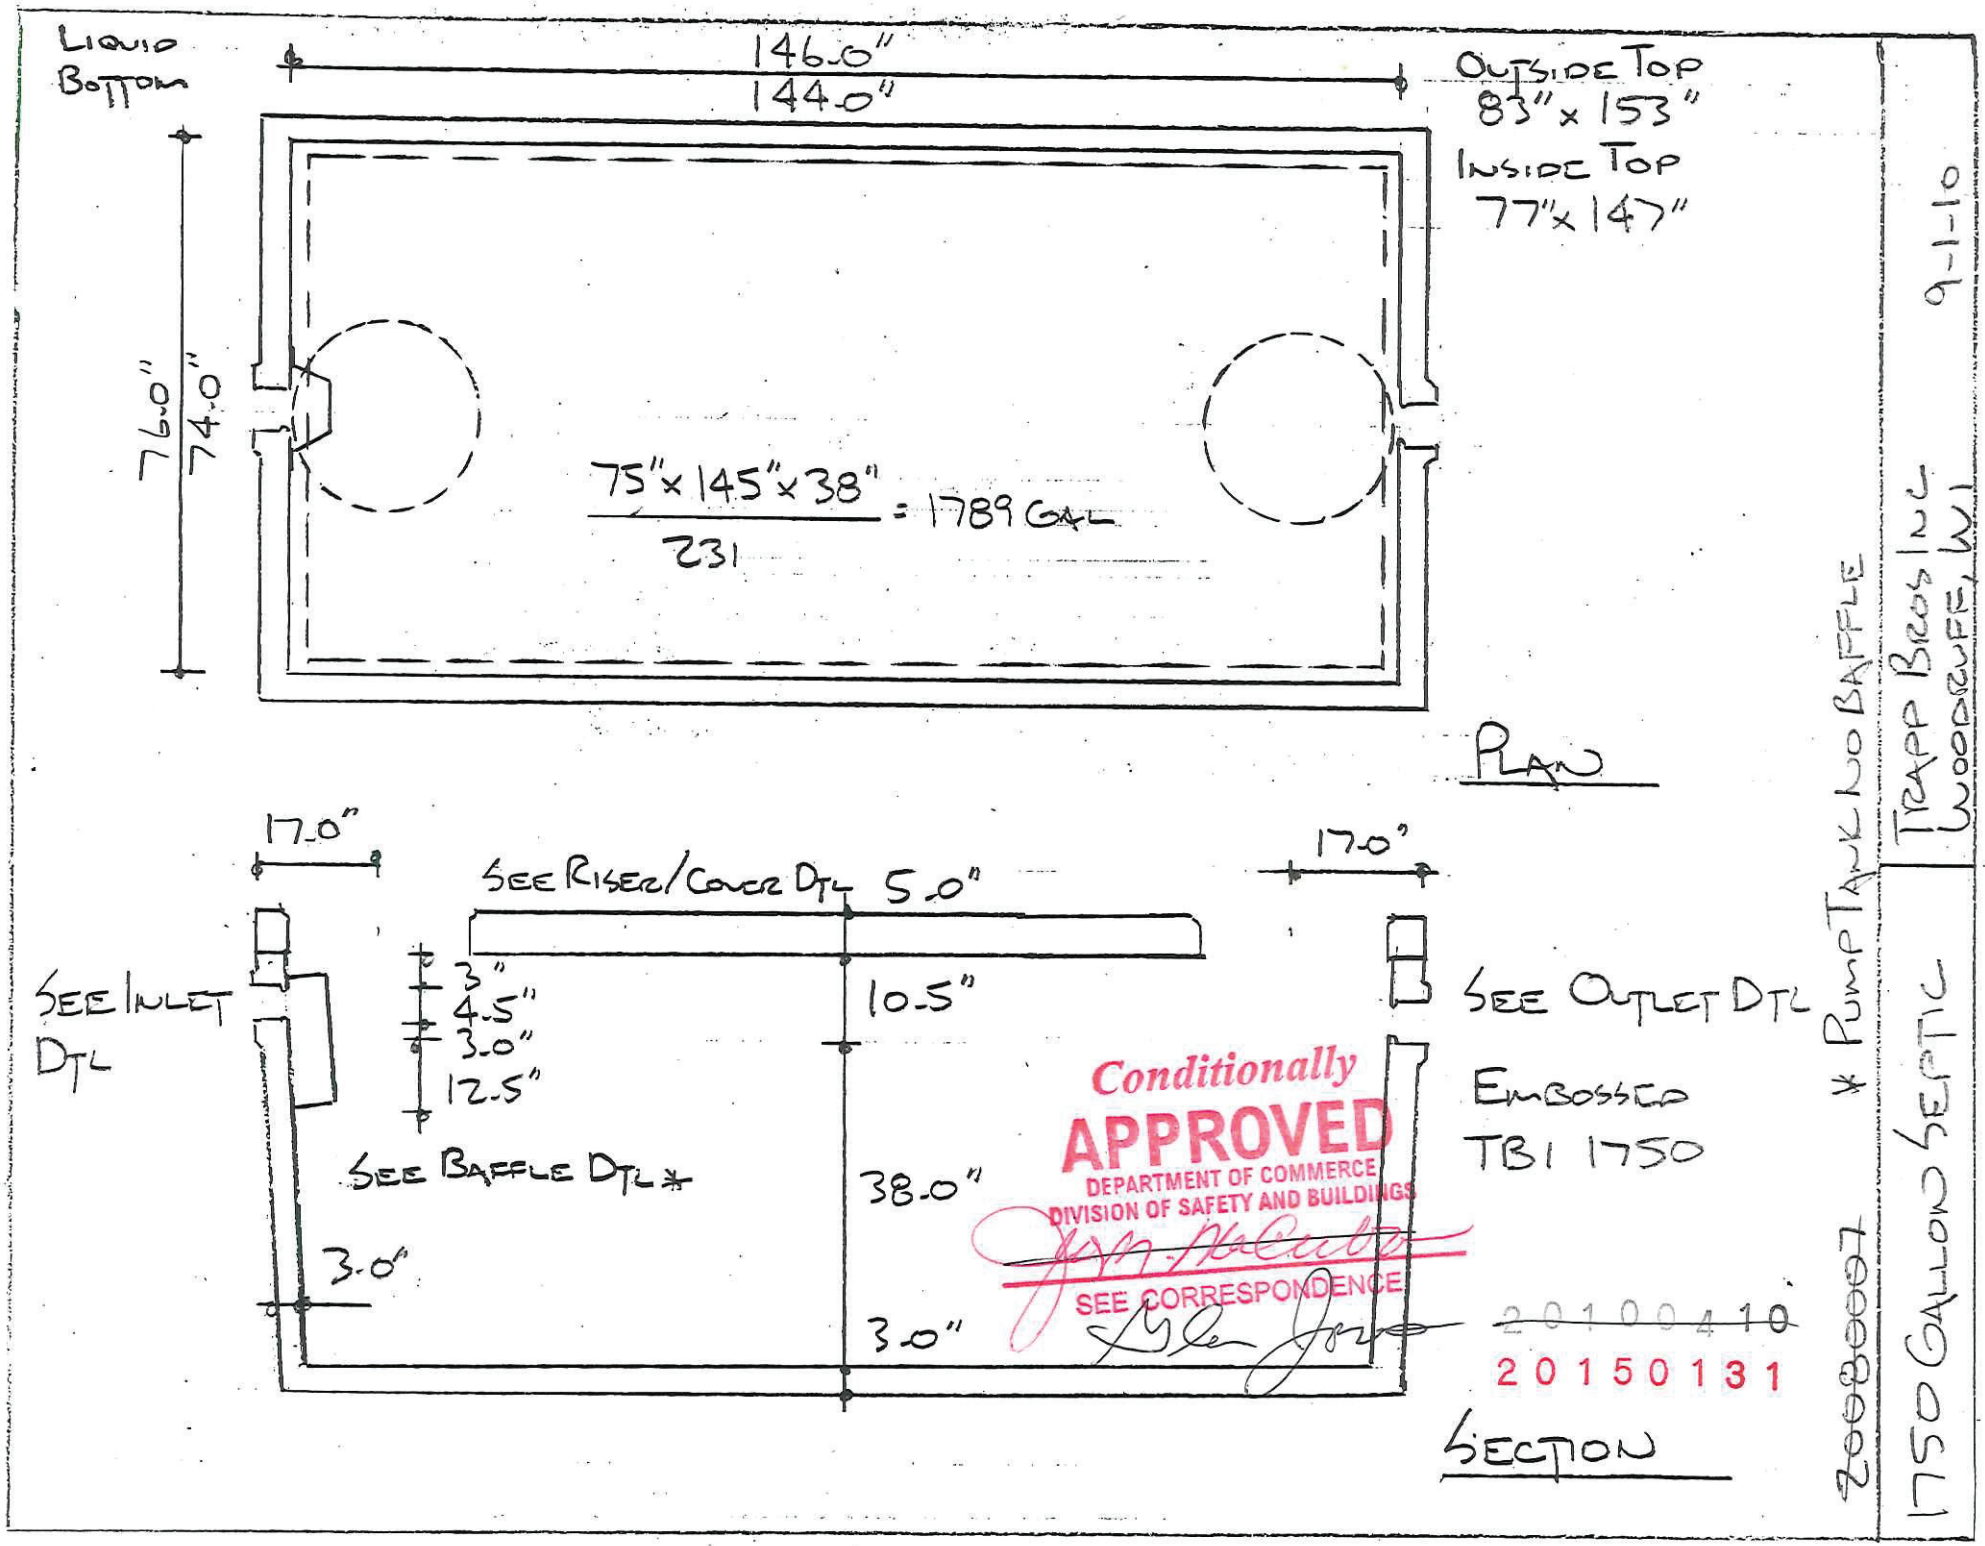
LIQUID BOTTOM
146.0"
144.0"
OUTSIDE TOP
83" x 153"
INSIDE TOP
77" x 147"
76.0"
74.0"
75" x 145" x 38" / 231 = 1789 GAL
PLAN
17.0"
SEE RISER/COVER DTL
5.0"
17.0"
SEE INLET DTL
3"
4.5"
3.0"
12.5"
10.5"
SEE OUTLET DTL
EMBOSSED TBI 1750
SEE BAFFLE DTL *
38.0"
3.0"
3.0"
Conditionally APPROVED
DEPARTMENT OF COMMERCE
DIVISION OF SAFETY AND BUILDINGS
SEE CORRESPONDENCE
20100410
20150131
SECTION
* PUMP TANK NO BAFFLE
TRAPP BROS INC
WOODRUFF, WI
9-1-10
1750 GALLON SEPTIC
20080007