

IN-GROUND GRAVITY DISPERSAL AREA


Stepped Elevation Trenches with Washed Aggregate



0.5" TO 2.5" WASHED AGGREGATE
 (min. 6.0" beneath distribution pipe
 - min. 2.0" over distribution pipe and
 covered with approved synthetic fabric)



SOIL COVER

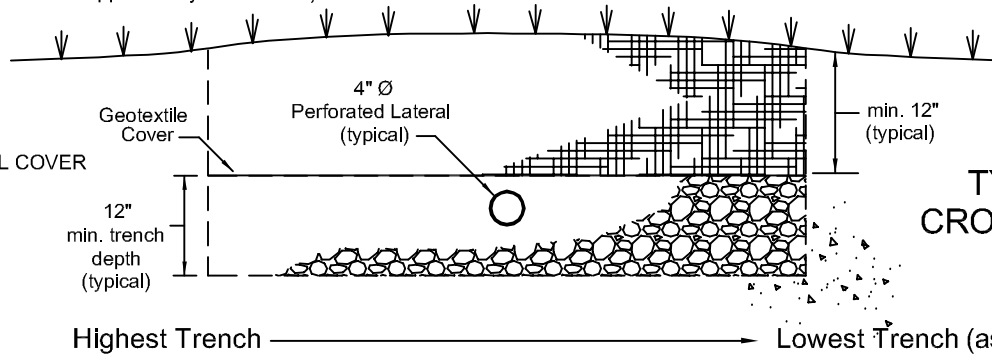

TYPICAL TRENCH
 CROSS SECTION VIEW
 (No Scale)


Highest Trench —————> Lowest Trench (as applicable)

System Elevations = _____ ft; _____ ft; _____ ft; _____ ft; _____ ft

Provide minimum 3 ft
 separation between trenches.

TYPICAL TRENCH
 PLAN VIEW
 (No Scale)

(Show location of inlet / outlet pipe connection on plan view.)

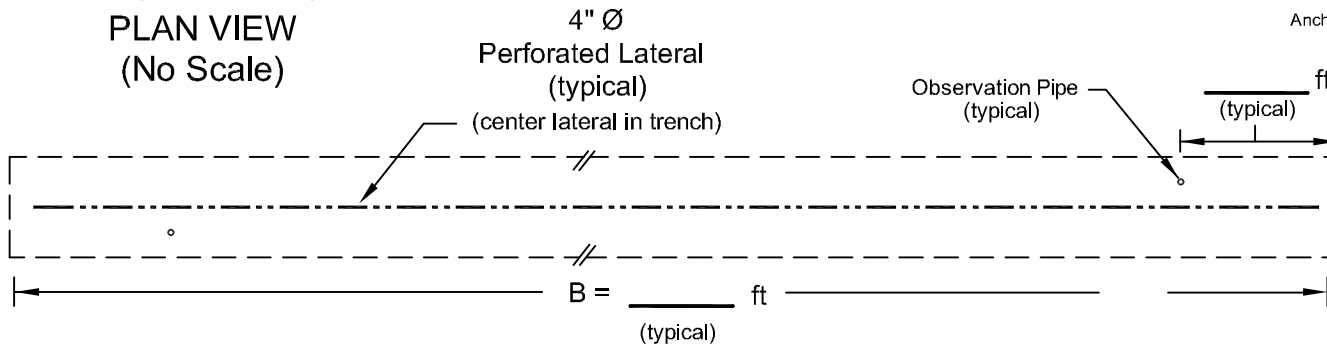

Required Infiltration Area = _____ ft²

Proposed Total Infiltration Area = _____ ft² per trench x _____ trenches = _____ ft²


Septic Tank(s) Manufacturer: _____

Septic Tank(s) Volume(s):
 _____ gal _____ gal _____ gal _____ gal

Effluent Filter Manufacturer: _____

Effluent Filter Model #: _____

OBSERVATION PIPE DETAIL
 (No Scale)

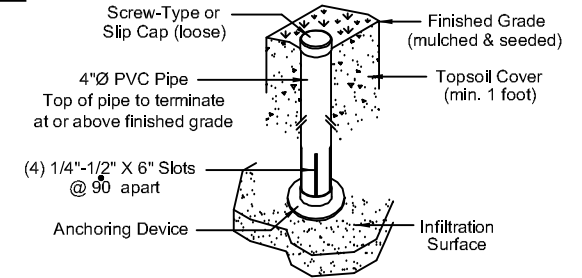

A = _____ ft
 (typical)

Distribution Method: _____