




DOUBLE-CELL MOUND DISPERSAL AREA UNIFORM CELL ELEVATIONS

 0.5" TO 2.5" WASHED AGGREGATE
(min. 6.0" beneath distribution pipe - min.2.0"
over distribution pipe and covered with
approved synthetic fabric)

 MIN. 6.0" OF TOPSOIL COVER


 ASTM C-33 SAND FILL

D = _____ ft

E = _____ ft


System Elevation = _____ ft

Lateral Invert Elevation = _____ ft

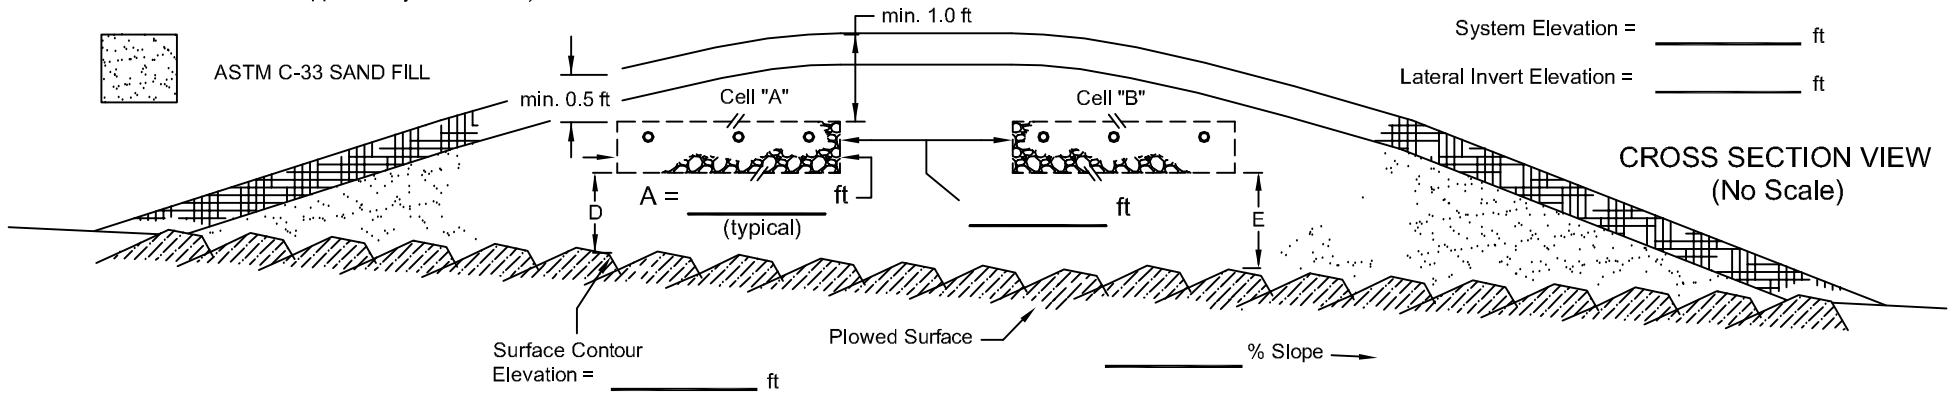

(Show force main, manifold, and flush valve locations on plan view.)

PLAN VIEW (No Scale)

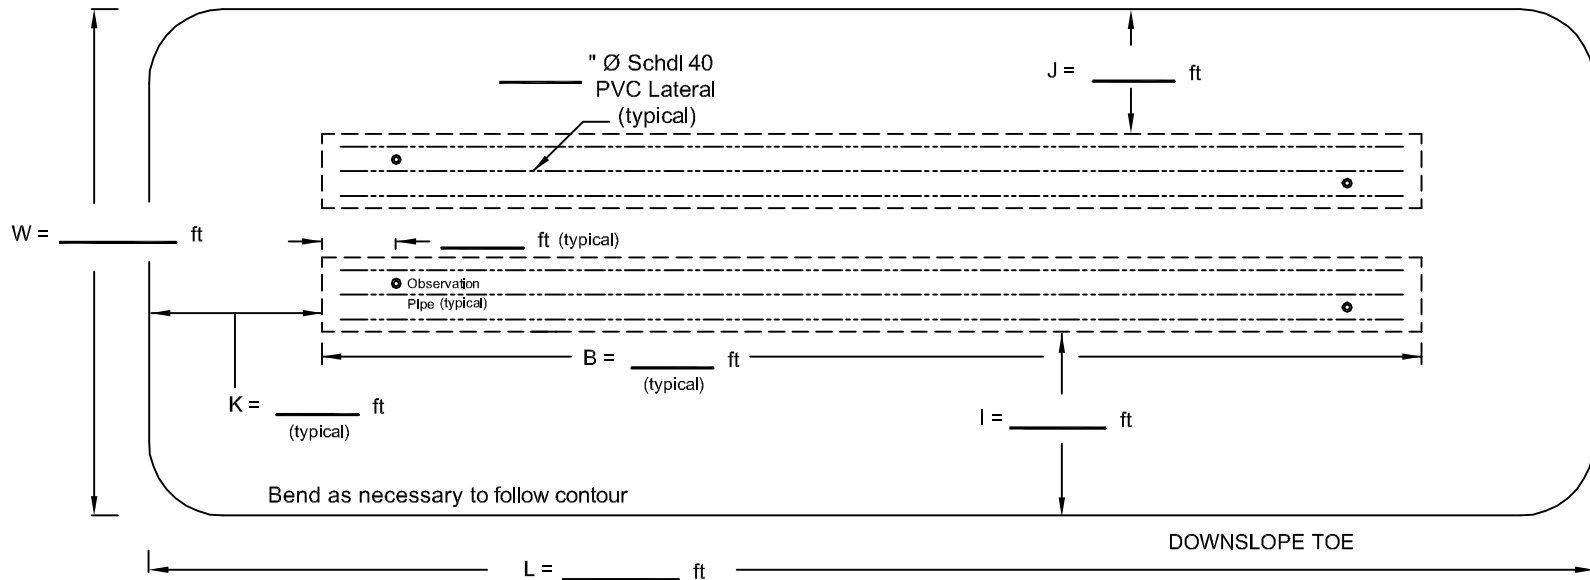

Prohibit disturbance and vehicular traffic
within 15 feet of downslope toe.