

# STEPPED-ELEVATION DOUBLE-CELL MOUND DISPERSAL AREA




MIN. 6.0" OF TOPSOIL COVER



0.5" TO 2.5" WASHED AGGREGATE  
(min. 6.0" beneath distribution pipe - min. 2.0"  
over distribution pipe and covered with  
approved synthetic fabric)




ASTM C-33 SAND FILL

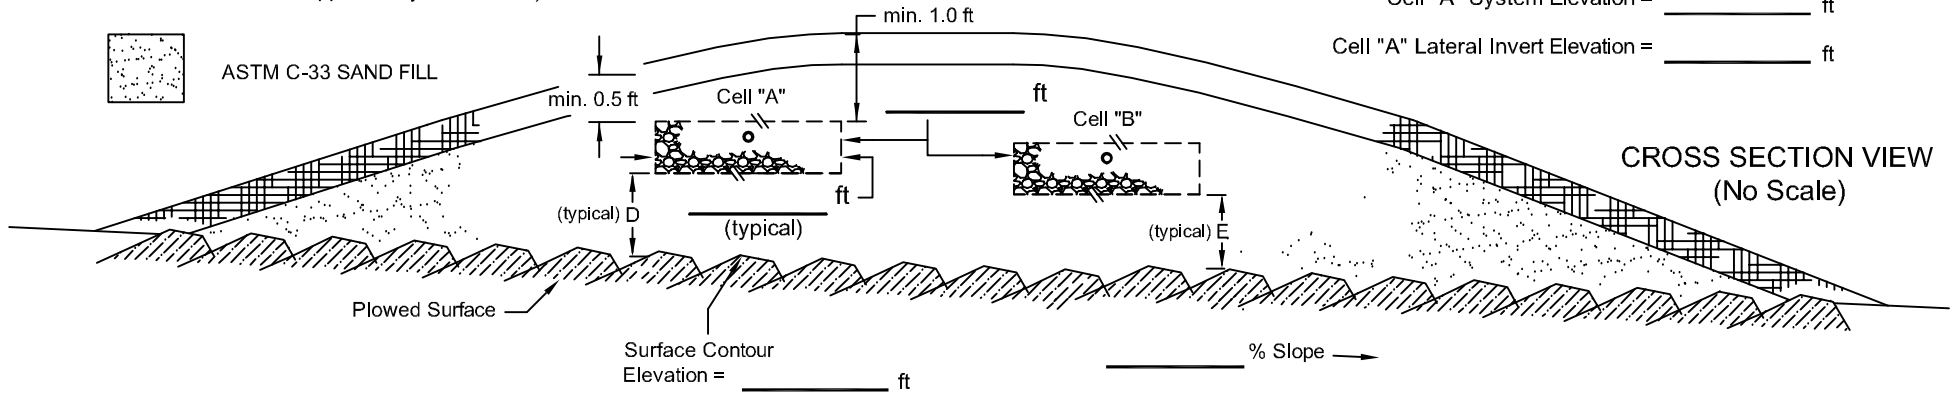

(Show force main, manifold, and flush valve locations on plan view.)

## PLAN VIEW (No Scale)

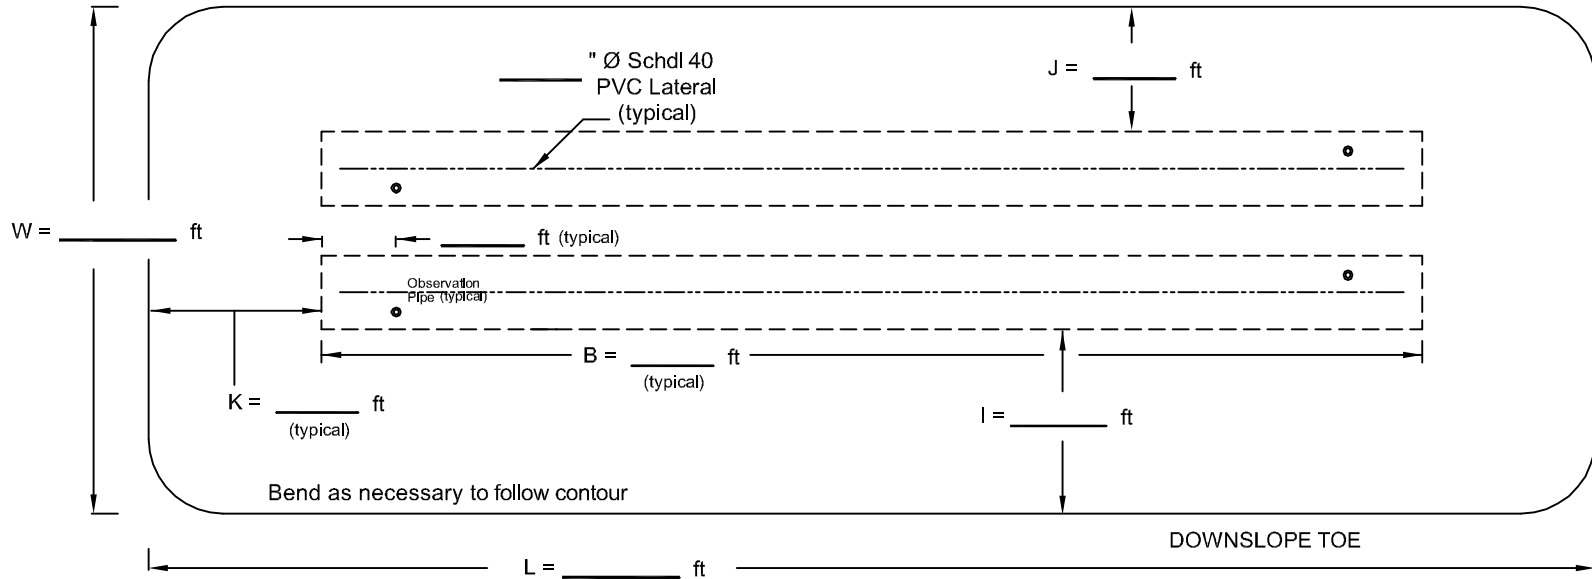

Prohibit disturbance and vehicular traffic  
within 15 feet of downslope toe.