

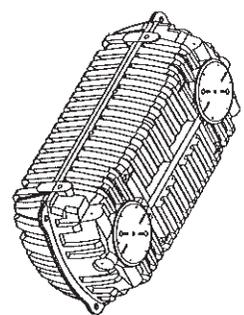
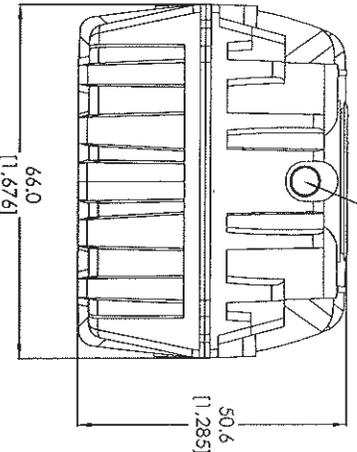


20130088

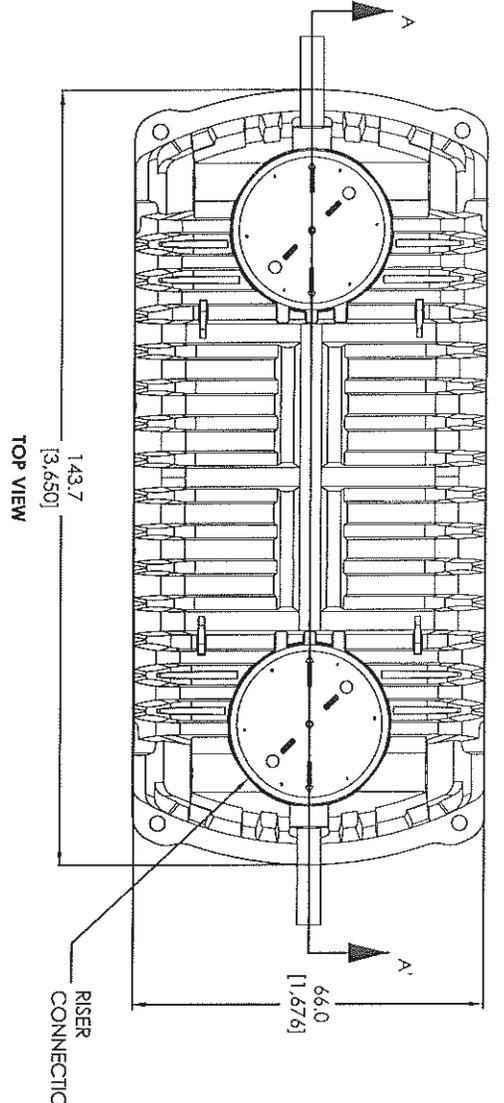

LETTERED DRILL LOCATIONS (SEE TABLE 2)

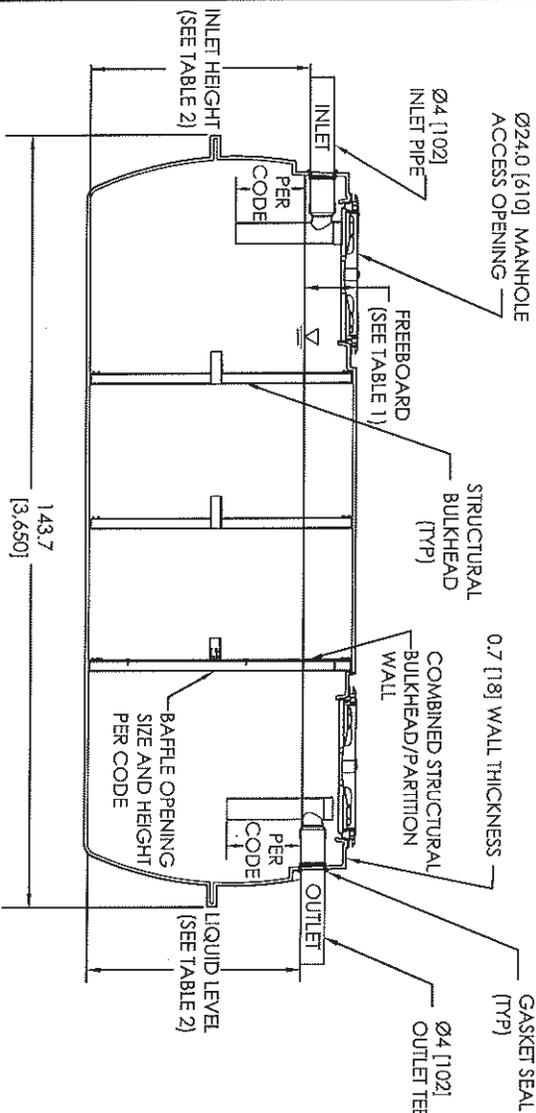

SECTION A-A'


TABLE 1 - SPECIFICATIONS

PARAMETER	UNITS	LIQUID LEVEL	LIQUID LEVEL
		U.S. [Metric]	IN [mm]
TOTAL VOLUME	gal [L]	1,448 [5,481]	1,448 [5,481]
WORKING VOLUME	gal [L]	1,254 [4,745]	1,261 [4,772]
TANK LENGTH	in [mm]	143.7 [3,650]	143.7 [3,650]
TANK WIDTH	in [mm]	66.0 [1,676]	66.0 [1,676]
TANK HEIGHT	in [mm]	50.6 [1,285]	50.6 [1,285]
FREEBOARD	in [mm]	10.1 [256]	9.8 [249]

TABLE 2 - INVERTS AND LIQUID LEVEL

INVERT DROP	INLET DRILL LOCATION	OUTLET DRILL LOCATION	INLET/INVERT HEIGHT	OUTLET/INVERT HEIGHT
IN [mm]			IN [mm]	IN [mm]
2.0 [51]	A	D	42.0 [1,067]	40.0 [1,016]
2.25 [57]	A	C	42.0 [1,067]	39.75 [1,010]
3.0 [76]	B	C	42.75 [1,086]	39.75 [1,010]

- GENERAL NOTES:**
1. Tank markings include: manufacturer name, liquid capacity, manufacture date, maximum burial depth, model number, inlet, and outlet and state-specific approval number.
 2. Maximum burial depth is 48 in [1,219 mm].
 3. Dimensions on drawing shown in inches [millimeters].
 4. Exterior of manhole cover includes the following warning: "DANGER DO NOT ENTER; POISON GASES" written in English, French and Spanish.
 5. Working volume, liquid level and freeboard vary based on elevation of outlet, which varies by code.
 6. This is a generic tank configuration. State, provincial or county regulations may require a different setup or features.
 7. Invert drop can be 2.0 in [51 mm], 2.25 in [57 mm] or 3.0 in [76 mm] depending on applicable regulations.

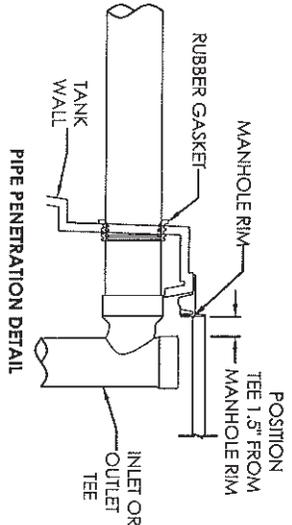



INFILTRATOR
septic tanks

INFILTRATOR SYSTEMS INC.
6 Business Park Rd., Old Saybrook, CT 06475
(800) 221-4435

TW-1250 DOUBLE COMPARTMENT
SEPTIC TANK CONFIGURATION

Drawn by: R.D.	DWG NO.: 1	Date: 12-05-08
SCALE: Not to Scale	Checked by: DJL	SHEET 1 of 1