W9100
TANK SPECIFICATIONS

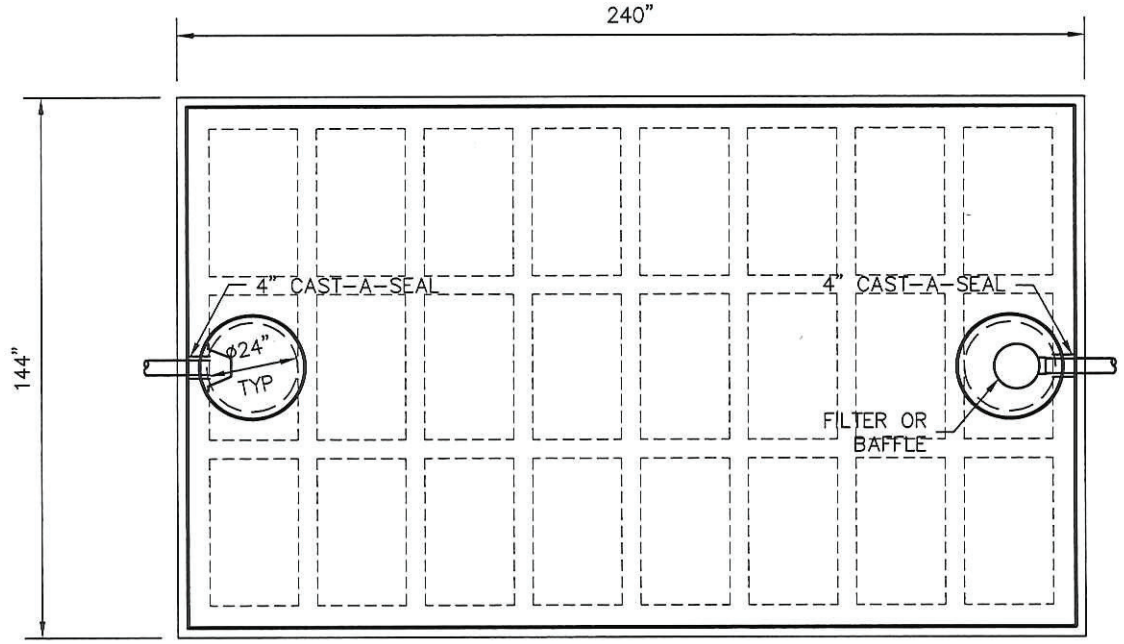

TOP VIEW

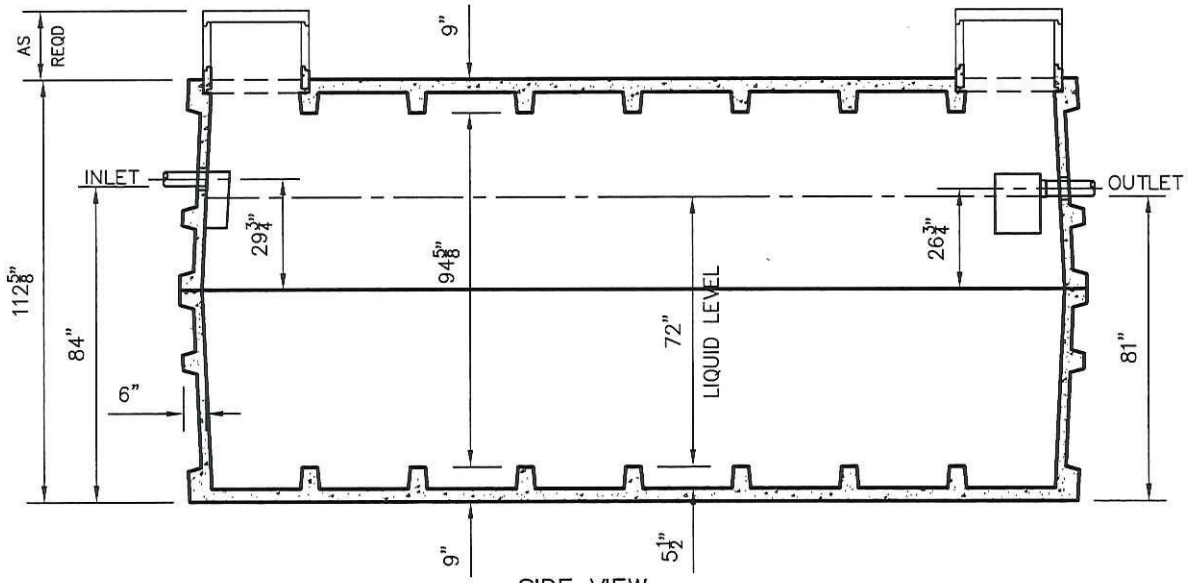

SIDE VIEW

TANKS ARE MANUFACTURED TO MEET OR EXCEED ASTM C-1227 REQUIREMENTS

DIMENSIONS:
- WALL: 6" RIBBED
- BOTTOM: 9" RIBBED
- COVER: 9" RIBBED
- MANHOLE: 24" I.D. PRECAST RISER
- HEIGHT: 112-5/8" O.D.
- LENGTH: 240" O.D.
- WIDTH: 144" O.D.
- BELOW INLET: 84" O.D.
- LIQUID LEVEL 72"
- WEIGHT: 29,000 LBS PER SECTION

INLET AND OUTLET:
- 4" CAST-A-SEAL BOOT OR EQUAL

INLET AND OUTLET BAFFLE AND FILTER:
- WISCONSIN, SEE DETAIL #10
- (OTHER STATES SEE CHART)

LIQUID CAPACITY: 126.90 GAL/IN

HOLDING TANK:
- OUTLET HOLE PLUGGED
- ACTUAL CAPACITY: 9,518 GALLONS

LOADING DESIGN: 8'-0" UNSATURATED SOIL

TANK CAN BE USED AS:
- SEPTIC/ HOLDING/ PUMP OR SIPHON

TANK: MIX DESIGN #9 (SMALL FIBER)

CUSTOMIZED TANKS:
- FOR CUSTOM TANKS CONTACT WIESER CONCRETE

Conditionally APPROVED

20140011

SEE CORRESPONDENCE

DRAWINGS SUBMITTED FOR APPROVAL

APPROVED BY: _____

APPROVAL DATE: _____

PRODUCTS NEEDED BY: _____

PRE-POUR:

POST-POUR:

SCALE: 1/4"=1'-0"

REV.

DRAWN BY: WCP

DATE: 00/00/00

DATE: .

FILE: W9100

WIESER CONCRETE
W3716 US HWY 10 MAIDEN ROCK, WI 54750
800-325-8456

W9100

SEPTIC MANUAL

SHEET NO. 1 OF 1

W12000
TANK SPECIFICATIONS

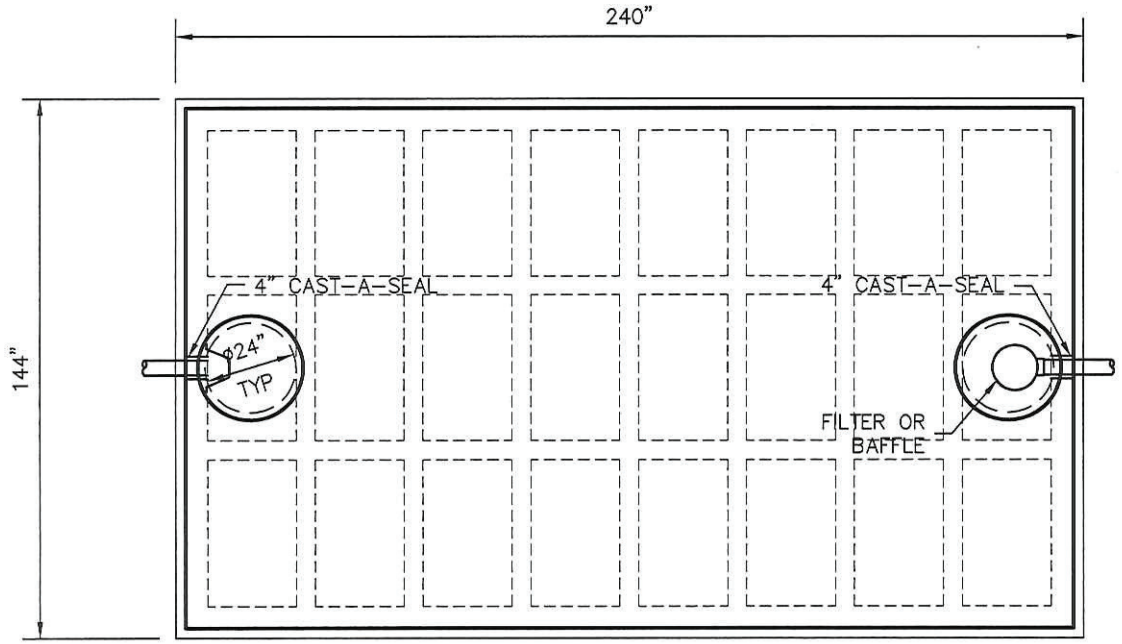

TOP VIEW

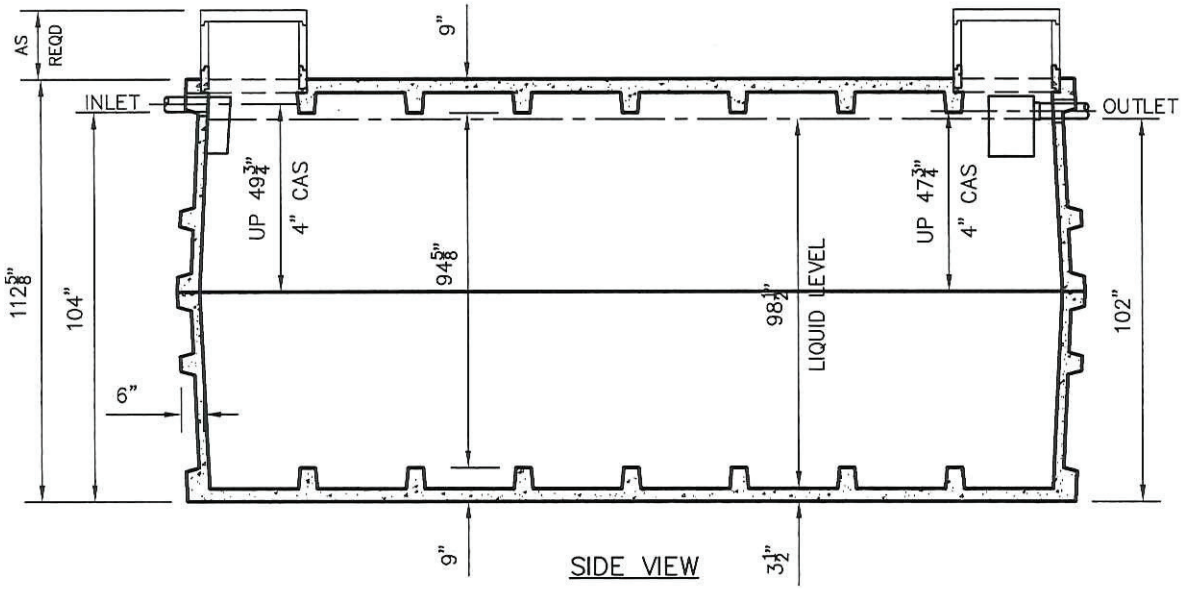

SIDE VIEW

TANKS ARE MANUFACTURED TO MEET OR EXCEED ASTM C-1227 REQUIREMENTS

DIMENSIONS:
- WALL: 6" RIBBED
- BOTTOM: 9"
- COVER: 9"
- MANHOLE: 24" I.D. PRECAST RISER
- HEIGHT: 112-5/8" O.D.
- LENGTH: 240" O.D.
- WIDTH: 144" O.D.
- BELOW INLET: 104" O.D.
- LIQUID LEVEL: 98.5"
- WEIGHT: 29,000 LBS PER SECTION

INLET AND OUTLET:
- 4" CAST-A-SEAL BOOT OR EQUAL

INLET AND OUTLET BAFFLE AND FILTER:
- WISCONSIN, SEE DETAIL #10
- (OTHER STATES SEE CHART)

LIQUID CAPACITY: 126.90 GAL/IN

HOLDING TANK:
- OUTLET HOLE PLUGGED
- ACTUAL CAPACITY: 12,055 GALLONS

LOADING DESIGN: 8'-0" UNSATURATED SOIL

TANK CAN BE USED AS:
- SEPTIC, HOLDING, PUMP OR SIPHON

TANK: MIX DESIGN #9 (SMALL FIBER)

CUSTOMIZED TANKS:
- FOR CUSTOM TANKS CONTACT WIESER CONCRETE

Conditionally APPROVED

SEE CORRESPONDENCE
20140011

DRAWINGS SUBMITTED FOR APPROVAL

APPROVED BY: _____

APPROVAL DATE: _____

PRODUCTS NEEDED BY: _____

PRE-POUR:
POST-POUR:
SCALE: 1/4"=1'-0"
REV.
DATE:
DRAWN BY: WCP
DATE: 00/00/00
FILE: W12000

WIESER CONCRETE
W3716 US HWY 10 MAIDEN ROCK, WI 54750
800-325-8456

W12000
SEPTIC MANUAL

SHEET NO. 1 OF 1