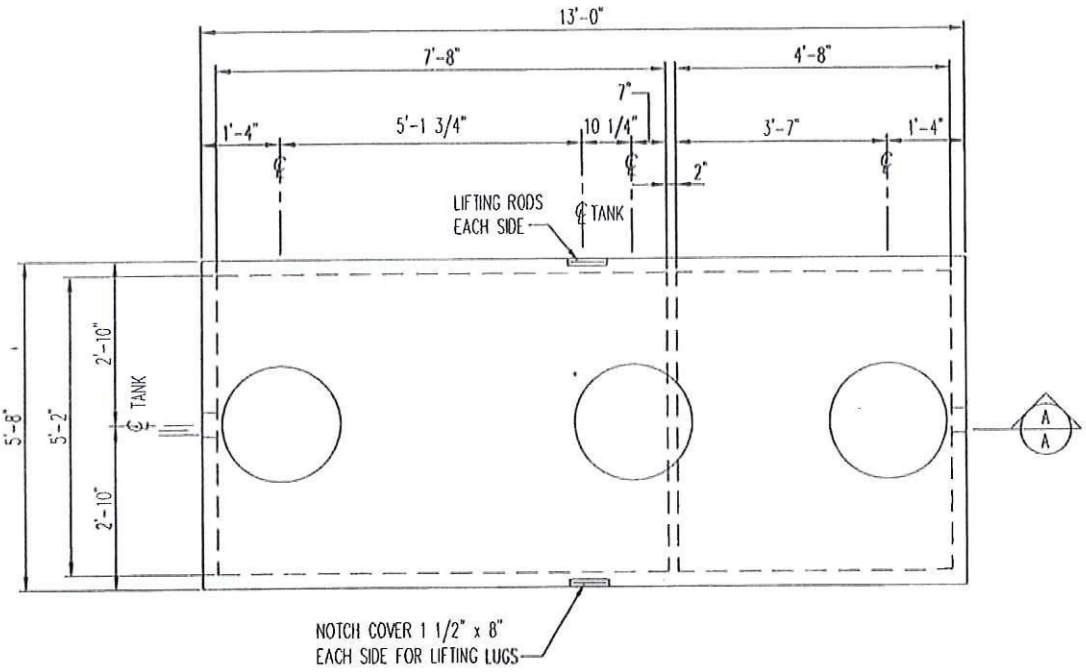

1600 GALLON 2 COMP. TANK
1/2" = 1'-0"

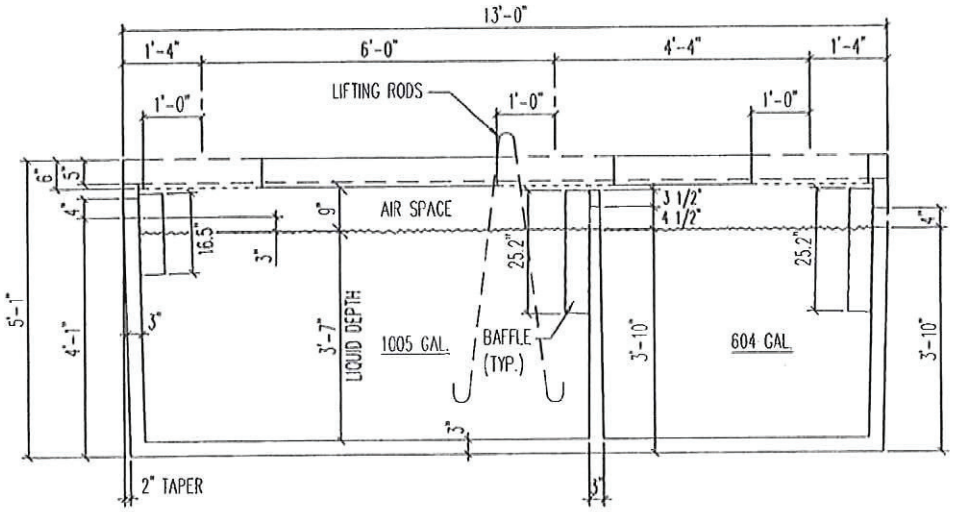

A
A
SECTION
1/2" = 1'-0"

NOTE:
1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.

Conditionally APPROVED
SEE CORRESPONDENCE

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1600 GALLON 2 COMP. SEPTIC TANK (1600 2C)	Brown Wilbert	WEIGHT=14,500# MAX. SOIL COVER= 7'-0" TOTAL LIQUID VOLUME= 1609 GAL.

20140125

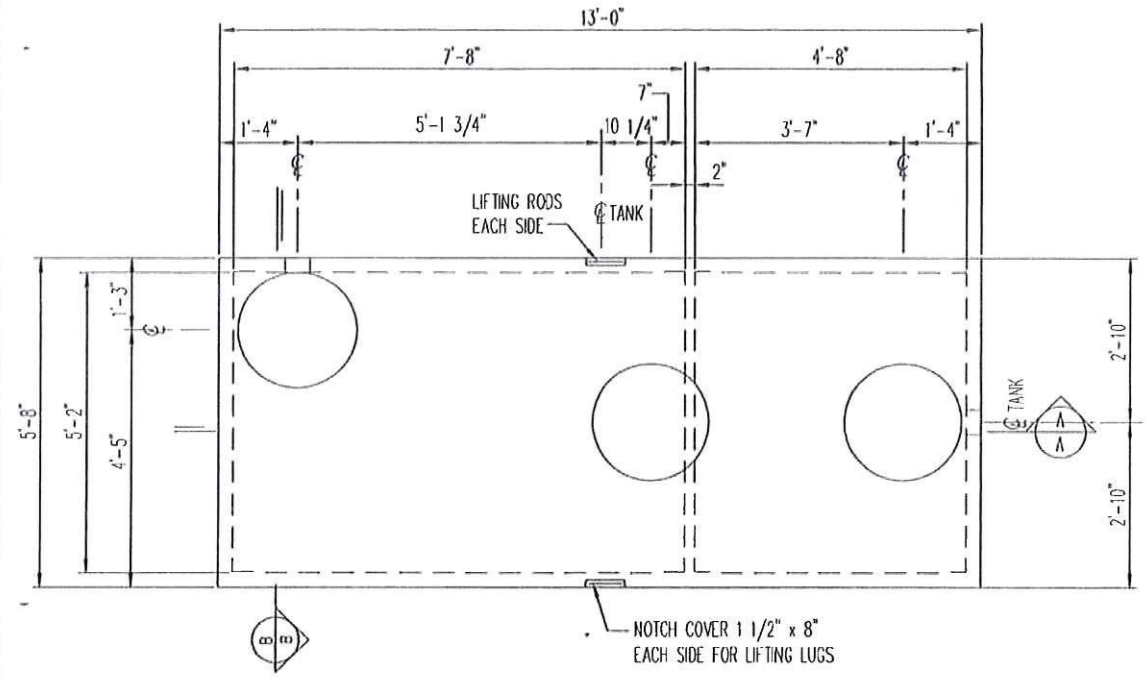

1600 GALLON 2 COMP. TANK
1/2" = 1'-0"

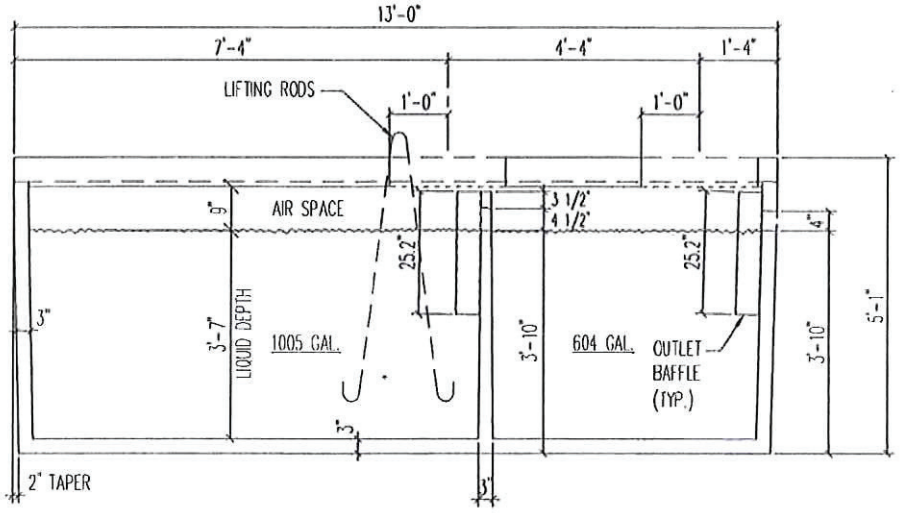

A
A
SECTION
1/2" = 1'-0"

NOTE:
1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.

Conditionally APPROVED
SEE CORRESPONDENCE

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1600 GALLON 2 COMP. SEPTIC TANK (1600 2C-L)	Brown Wilbert	WEIGHT=14,500# MAX. SOIL COVER= 7'-0" TOTAL LIQUID VOLUME= 1609 GAL.

20140125

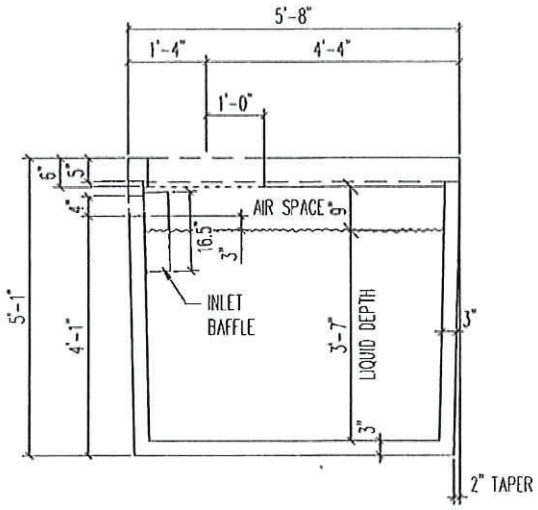

B/B SECTION

1/2" = 1'-0"

Conditionally APPROVED

SEE CORRESPONDENCE

NOTE:

1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1600 GALLON 2 COMP. SEPTIC TANK (1600 2C-L)	Brow Wilbert	WEIGHT=14,500# MAX. SOIL COVER= 7'-0" TOTAL LIQUID VOLUME= 1609 GAL.

20140125

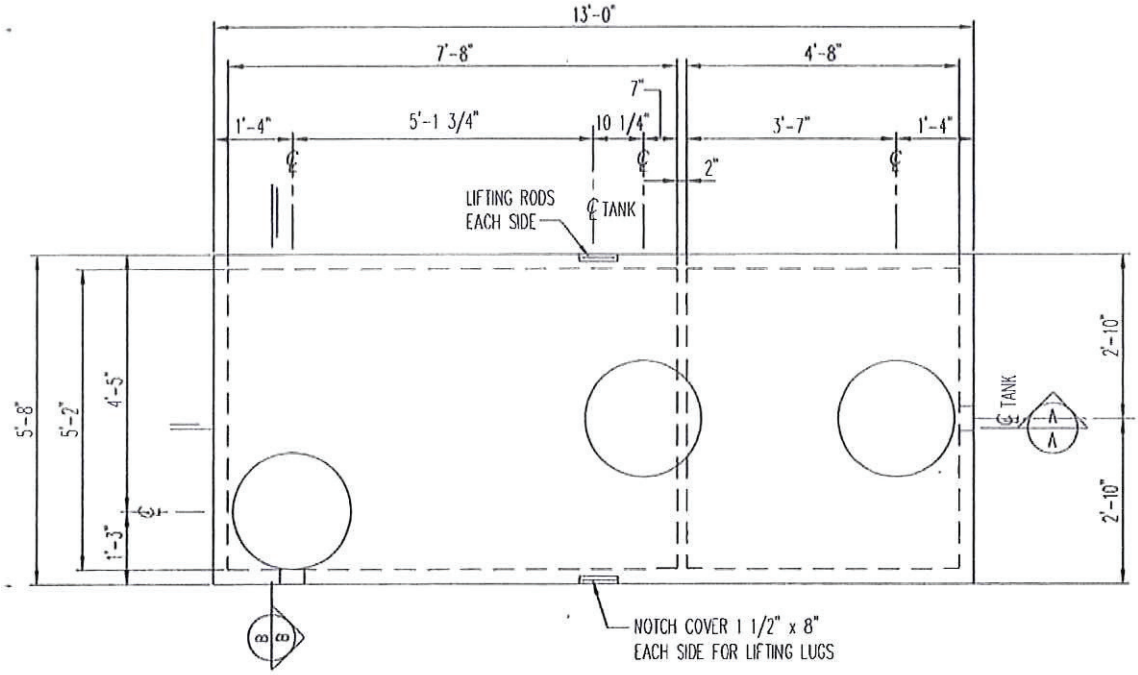

1600 GALLON 2 COMP. TANK
1/2" = 1'-0"

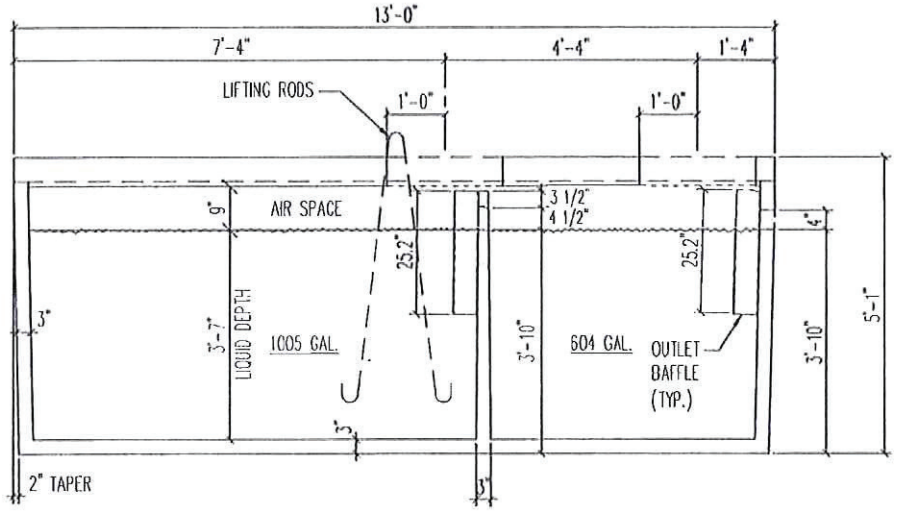

A
A
SECTION
1/2" = 1'-0"

NOTE:
1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.

Conditionally APPROVED
SEE CORRESPONDENCE

RECEIVED
APR 16 2014
SAFETY & BUILDINGS

1600 GALLON 2 COMP. SEPTIC TANK (1600 2C-R)	Brown Wilbert	WEIGHT=14,500# MAX. SOIL COVER= 7'-0" TOTAL LIQUID VOLUME= 1609 GAL.

20140125

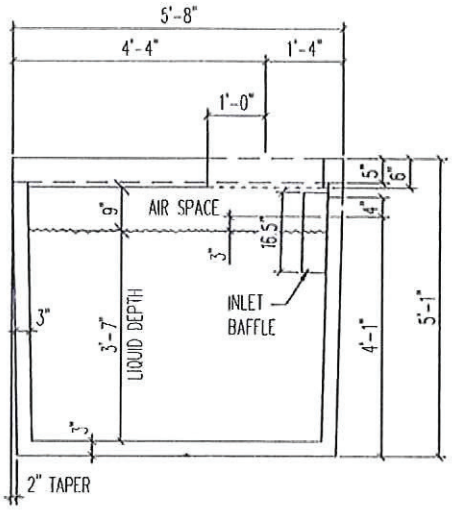

B/B SECTION

1/2" = 1'-0"

Conditionally APPROVED

SEE CORRESPONDENCE

NOTE:

1 PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.

RECEIVED

APR 16 2014

SAFETY & BUILDINGS

1600 GALLON 2 COMP. SEPTIC TANK (1600 2C-R)	Brown Wilbert	WEIGHT=14,500# MAX. SOIL COVER= 7'-0" TOTAL LIQUID VOLUME= 1609 GAL.

20140125