20140316

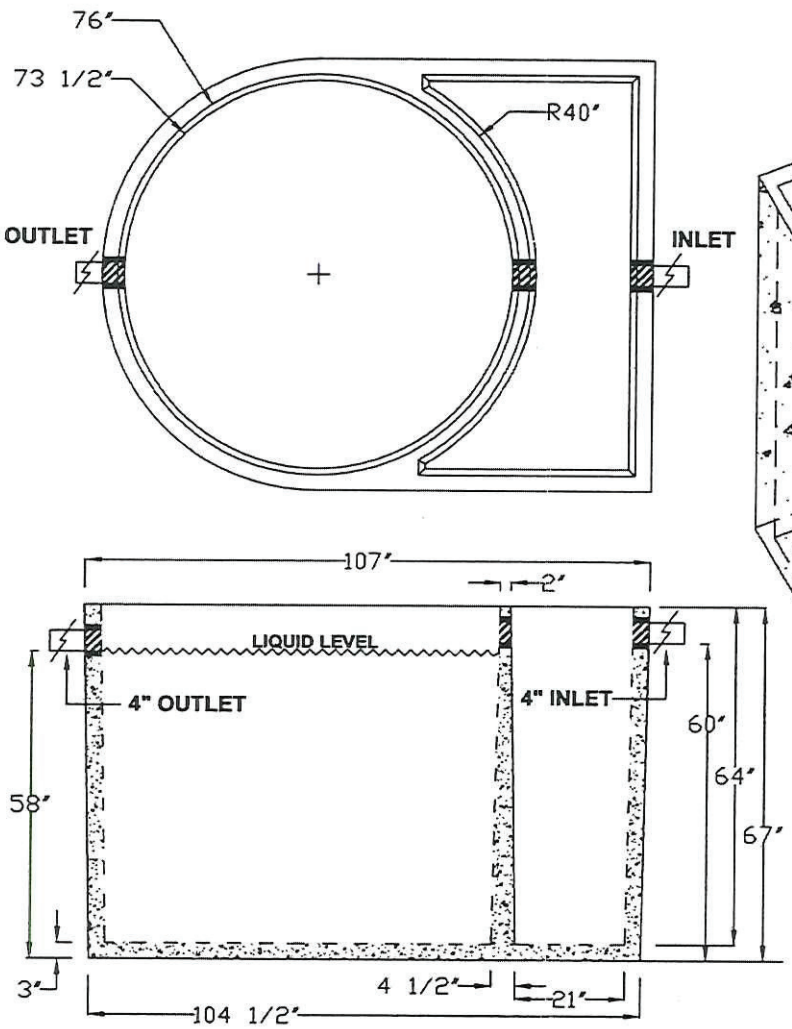

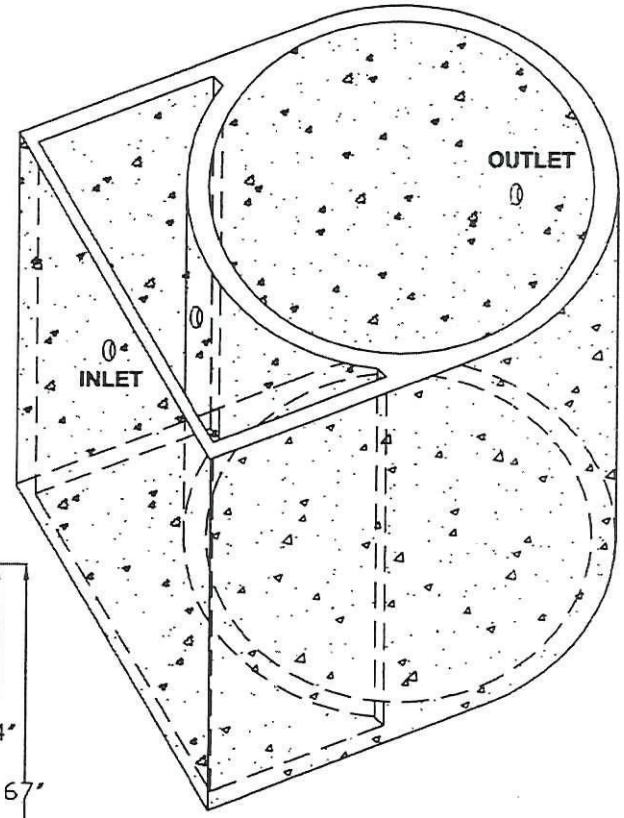

GROVE CONCRETE & SUPPLY, INC.
18426 DURAND AVENUE P.O. BOX 363
UNION GROVE, WISCONSIN 53182
(262) 878-2030 FAX (262) 878-4222
GroveConcrete.com

NOTES:

1. PRETREAT TANK VOLUME = 502.5 GALLONS @ 55" DEEP.
2. REINFORCED CONCRETE 4,000 PSI MIN. (2.31 CUBIC YARDS).
3. ALL BAFFLES & FILTERS TO BE INSTALLED TO MEET STATE & LOCAL CODES.

CLEARSTREAM AEROBIC
600NC2T CONCRETE TANK
W/500 GAL. SQUARE PRETREAT TANK

FOR ANY MODIFICATIONS CALL
GROVE CONCRETE

DRAWN BY: RAY		DATE: 12/20/13
SCALE: NTS	EST. WIEGHT: 9,240 LBS.	VERSION: 00001
DWG. # 600NC2T		ILL. APPROVAL # 114
		NOT WIS. APPROVED

THIS DRAWING AND THE INFORMATION CONTAINED HEREON IS THE EXCLUSIVE PROPERTY OF GROVE CONCRETE & SUPPLY, INC., AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS EXCEPT AS AUTHORIZED THROUGH WRITTEN CONCENT FROM GROVE CONCRETE & SUPPLY, INC.

Conditionally APPROVED

SEE CORRESPONDENCE

20140316

DESIGN DRAWINGS

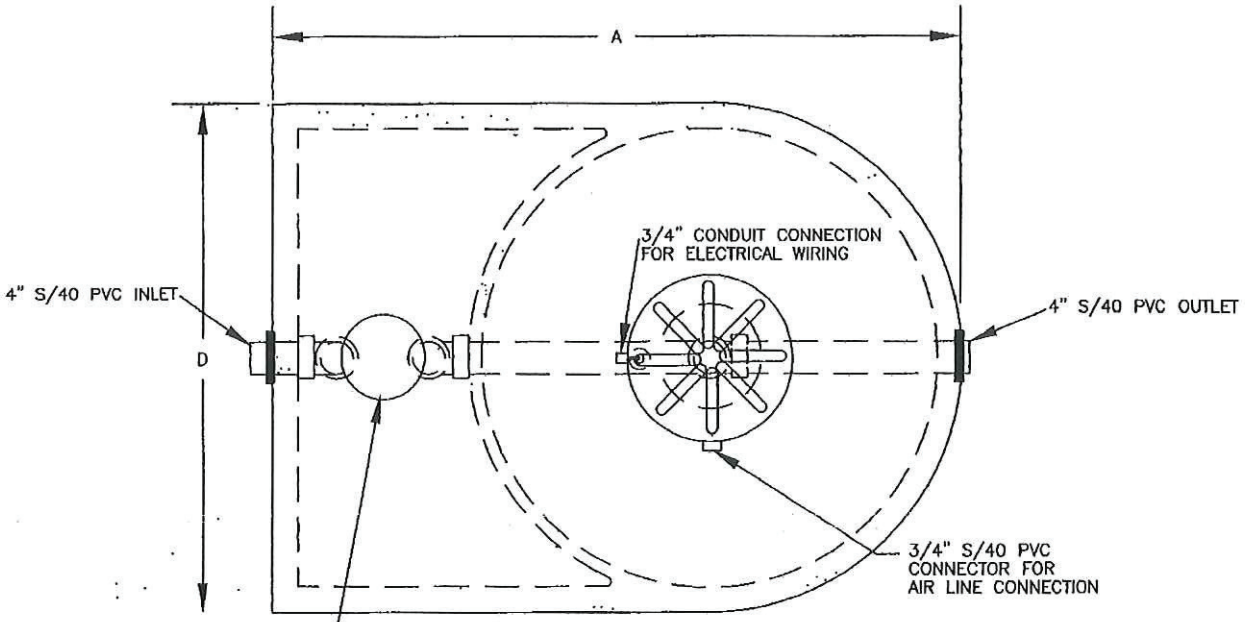

PLAN VIEW

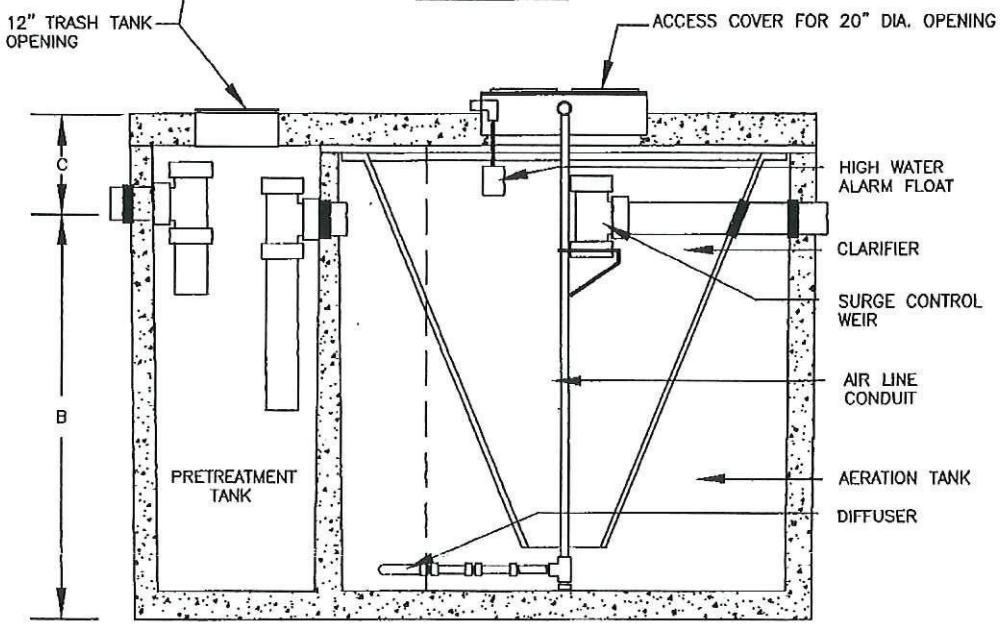

MODEL NC2
SECTION

DIMENSIONAL DATA

MODEL	A	B	C	D
500 NC2	104"	60"	10-1/2"	75"
600 NC2	107"	60"	10-1/2"	82"
750 NC2	107"	70"	10-1/2"	82"
800 NC2	107"	72"	8-1/2"	82"

Conditionally
APPROVED

SEE CORRESPONDENCE