




# DOUBLE-CELL MOUND DISPERSAL AREA UNIFORM CELL ELEVATIONS

 0.5" TO 2.5" WASHED AGGREGATE  
(min. 6.0" beneath distribution pipe - min.2.0"  
over distribution pipe and covered with  
approved synthetic fabric)

 MIN. 6.0" OF TOPSOIL COVER


 ASTM C-33 SAND FILL

D = \_\_\_\_\_ ft

E = \_\_\_\_\_ ft


System Elevation = \_\_\_\_\_ ft

Lateral Invert Elevation = \_\_\_\_\_ ft

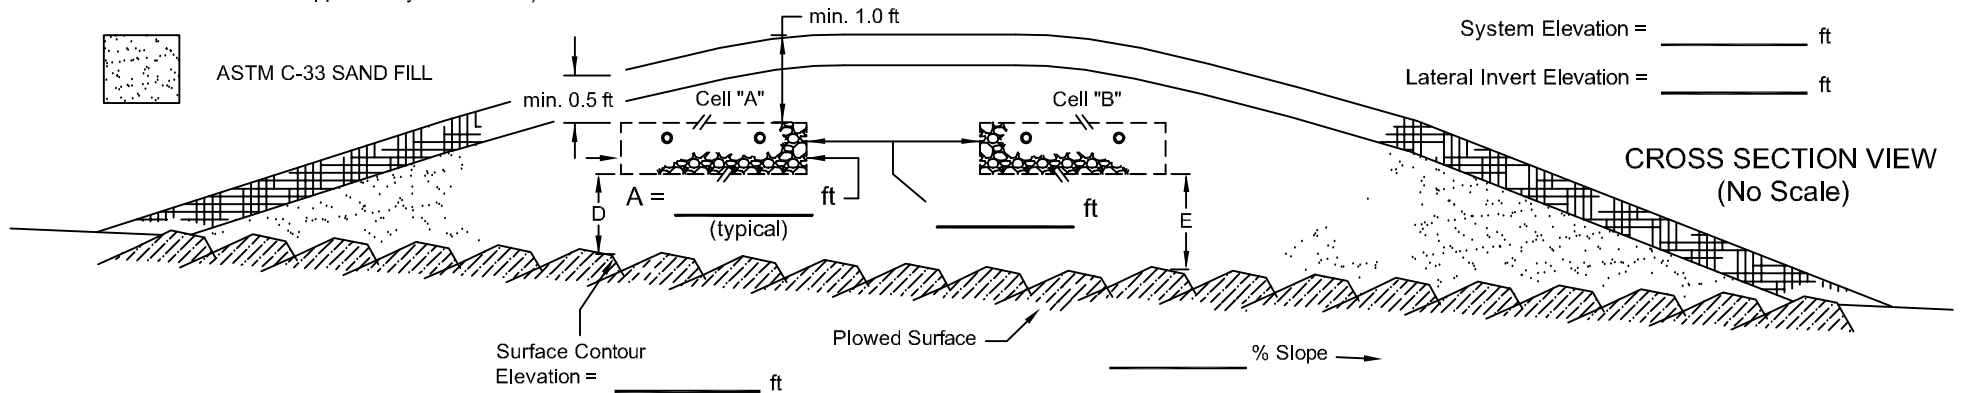

(Show force main, manifold, and flush valve locations on plan view.)

## PLAN VIEW (No Scale)

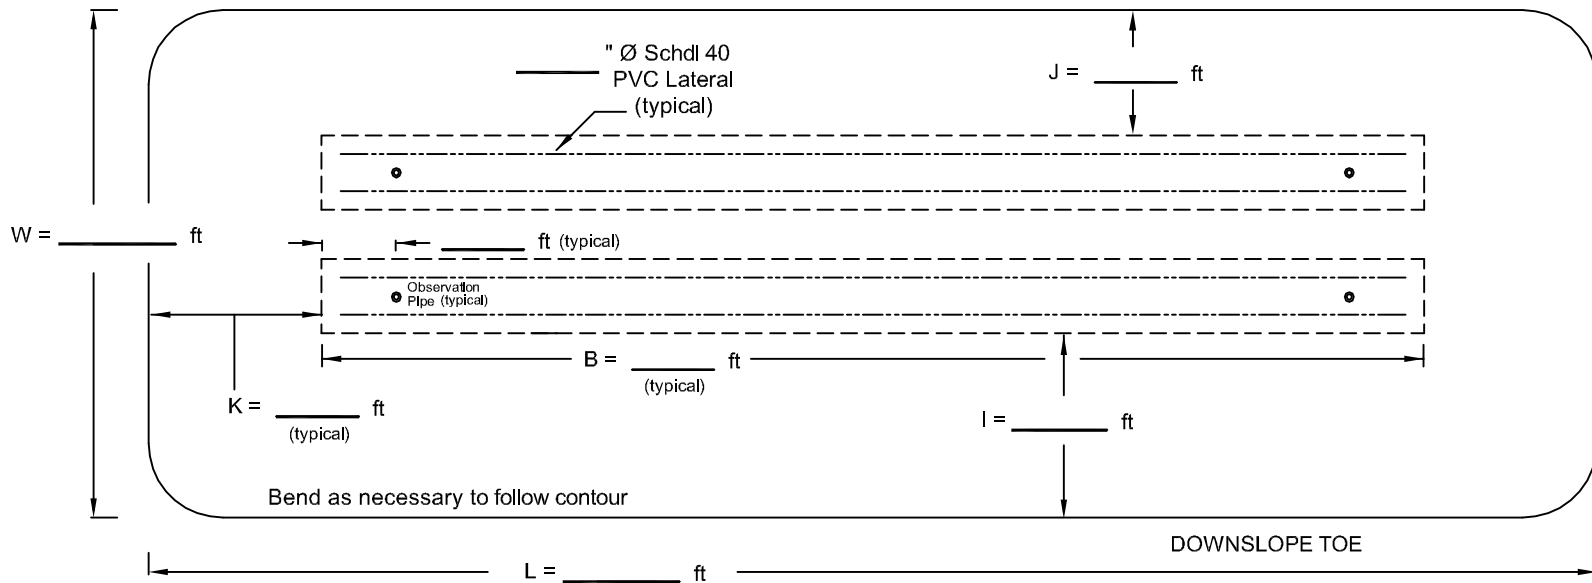

Prohibit disturbance and vehicular traffic  
within 15 feet of downslope toe.